

TEST LINK BOARD

Instrument Specification

A900



Test Link Board, indicates WTI CT current and allows safe current injection for WTI calibration



- Allows existing WTI to indicate Oil Temperature for CT calibration
- Provision for external injection of CT current for WTI calibration
- Class 1.5 Ammeter
- 0-5, 0-10 & 0-20 ammeters available
- Suitable for up to 20 amp C.T.
- 2000 volts isolation
- Can be supplied detailing transformer specific gradient and resistance values
- Optional Perspex cover provided




Issued: May 2005

Accurate Controls Ltd.
25 Cowley Road, Nuffield Industrial Estate,
Poole, Dorset, BH17 0UJ, United Kingdom.
Tel: +44 (0)1202 678108
Fax: +44 (0)1202 670161
e-mail: info@accurate-controls.ltd.uk
web: www.accurate-controls.ltd.uk



© ACL 2005

Dimensions

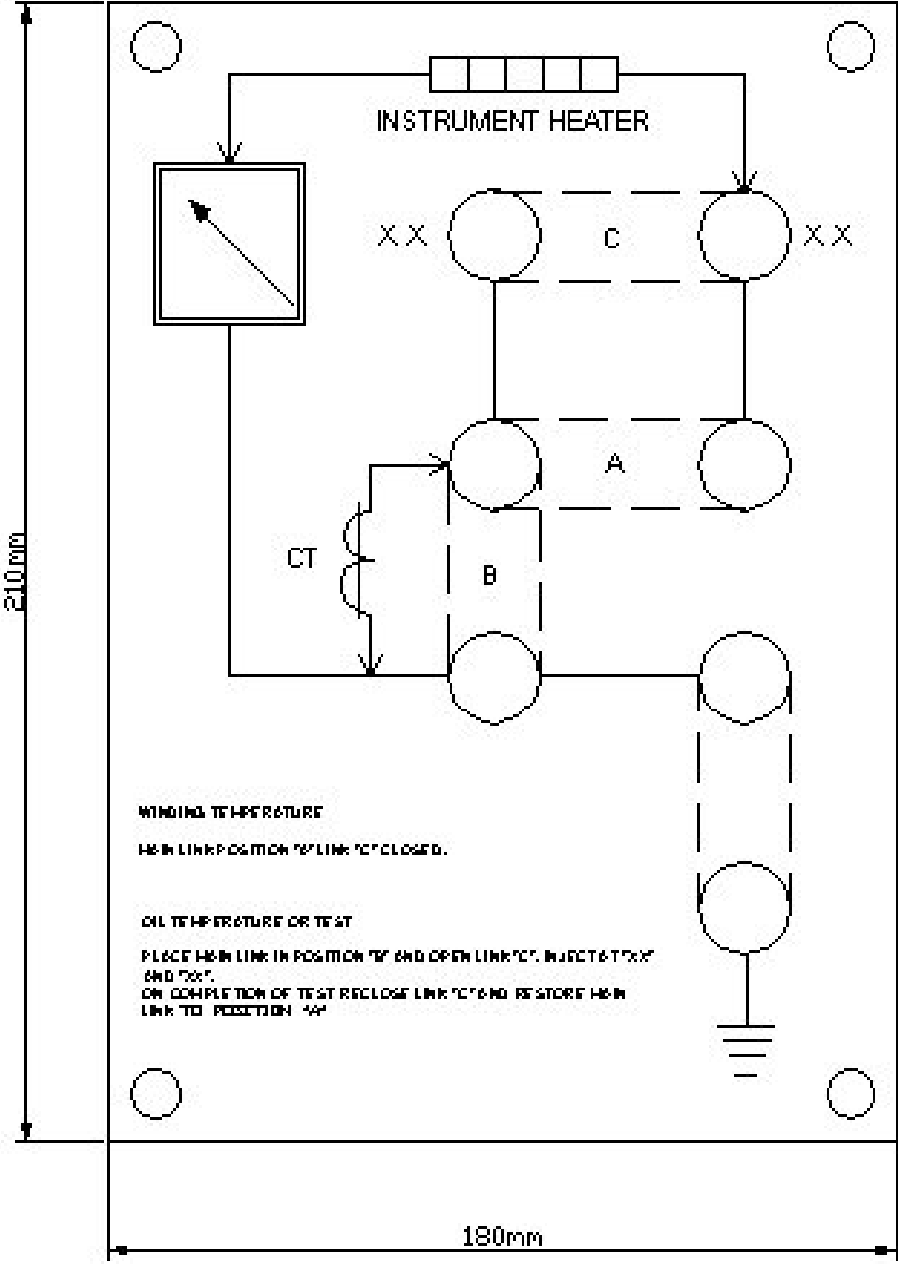

Please specify ammeter and gradient requirement at time of order

On site installation service available by Accurate Controls Ltd.
Please contact Accurate Controls Ltd. for further information