

Residual current monitor RCMA470LY

AC / DC sensitive residual current monitor
for TN and TT systems
(AC, DC and pulsed DC currents)



Device features

- External measuring current transformer
- Two separately adjustable response values, Alarm $I_{\Delta n1}$: 30 mA...3 A (0...150 Hz) prewarning $I_{\Delta n2}$: 50 % / 100 % of $I_{\Delta n1}$
- Adjustable response delay 0...10 s (prewarning 0 / 1 s)
- Two separate alarm relays with one changeover contact each
- N/O or N/C operation
- Fault memory
- Combined TEST and RESET button
- Connection external TEST and RESET button
- LED bar graph indicator $I_{\Delta n}$ 0...100 %
- Connection external measuring instrument $I_{\Delta n}$ 0...100 %
- CT connection monitoring
- Sealable transparent cover
- Separate supply voltage
- Type B acc. to IEC 60755

Approvals



Product description

The AC / DC sensitive residual current monitor RCMA470LY is designed for monitoring earthed power supply systems (TN and TT systems) where DC fault currents or residual currents continuously greater than zero may occur. These are in particular loads containing six-pulse rectifiers or one way rectifiers with smoothing, such as converters, battery chargers, construction site equipment with frequency-controlled drives.

The prewarning stage (50 % of the set response value $I_{\Delta n1}$) allow to distinguish between prewarning and alarm. Since the values are measured with measuring current transformers, the device is nearly independent of the load current and the nominal voltage of the system. The device can also be used for busbar systems.

Application


- AC / DC sensitive residual current monitoring in earthed two, three or four conductor systems.
- AC / DC sensitive current monitoring of single conductors de-energized under normal conditions (e. g. N and PE conductors).
- Variable-speed drives
- Uninterruptible power supply systems (UPS)
- Construction site equipment
- Wood working machines
- Battery systems
- Computer tomographs
- Laboratory equipment
- Photovoltaic systems
- Furniture industry
- Sewage works

Function


Residual current monitoring takes place via an external measuring current transformer. When the residual current respectively the current exceeds the set response value, the alarm LED lights and the associated alarm relay switches when the response delay has elapsed.

The alarm messages are stored. The fault memory can be reset by pressing the RESET button. The device function can be tested using the TEST button.

The currently measured value in per cent related to the set response value is shown on the LED bar graph indicator. The CT circuit is continuously monitored. In case of wire breakage, the alarm relay switches and the Power On LED flashes.

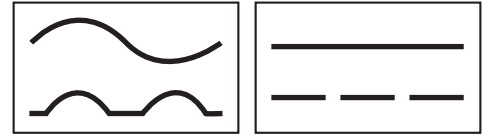


Wiring diagram – system connection, external connections

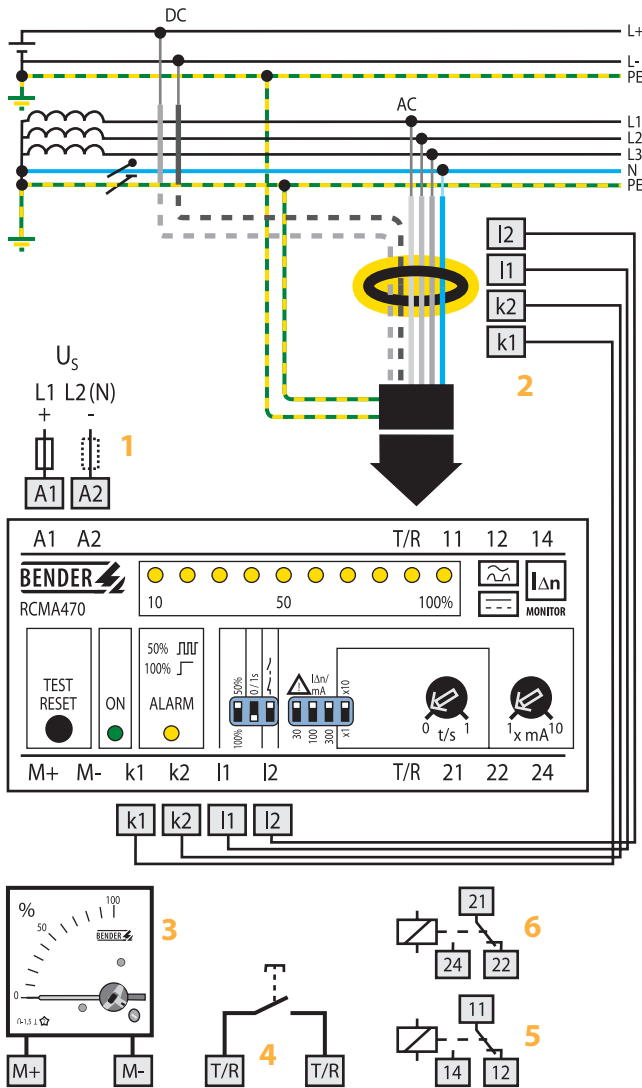

- 1 - Supply voltage U_s (see ordering information), a 6 A fuse recommended for line protection.
- 2 - External measuring current transformer W...B
- 3 - External measuring instrument
- 4 - External TEST and RESET button
- 5 - Alarm relay: switches when the fault current exceeds the response value $I_{\Delta n1}$ (alarm) and in case of interruption of the CT connection.
- 6 - Alarm relay: switches when the fault current exceeds 50 % or 100 % of the response value $I_{\Delta n1}$.

Do not route the PE conductor through the measuring current transformer!

Wiring diagram – front plate

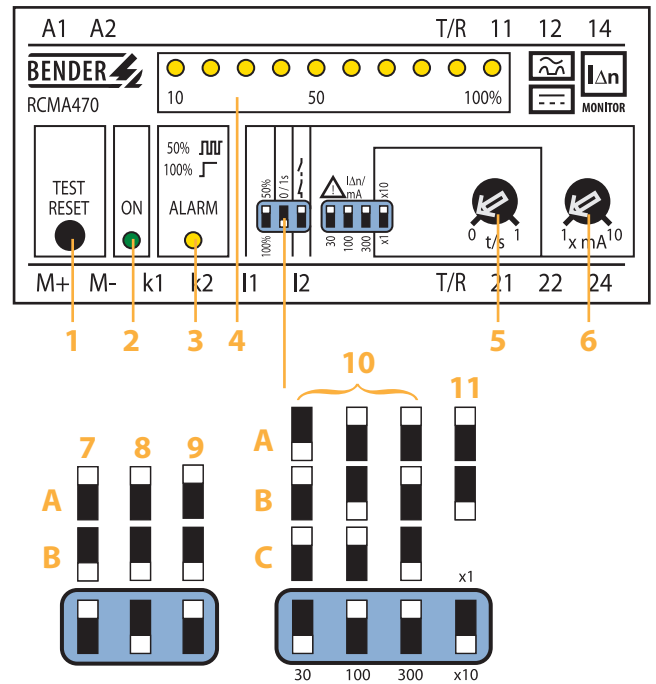

- 1 - Combined TEST and RESET button: short-time pressing (< 1 s) = RESET, long-time pressing (> 2 s) = TEST.
- 2 - Power On LED: lights when the device is in operation and flashes in case of interruption of the CT connection, defective CT or when the measuring range is exceeded.
- 3 - Alarm LED: lights when the fault current exceeds the set response value and flashes when 50 % of the set response value are reached.
- 4 - LED bar graph indicator, shows the measuring value in per cent related to the preset response value.
- 5 - Potentiometer for setting the response delay (0...1 s).
- 6 - Potentiometer for setting the response value (x 1...10 mA).

Setting of the DIP switches (white = switch position)

- 7 - Prewarning contact 21-22-24
 - A - Prewarning at 50 % of $I_{\Delta n1}$
 - B - Prewarning at 100 % of $I_{\Delta n1}$
- 8 - Response delay prewarning
 - A - Delay 1 s
 - B - Delay 0 s
- 9 - Alarm relay
 - A - N/O operation
 - B - N/C operation
- 10 - Response range
 - A - 30 mA
 - B - 100 mA
 - C - 300 mA

} x 1...10
- 11 - Response delay
 - A - Setting value $\frac{1}{5} \times 10$
 - B - Setting value $\frac{1}{5} \times 1$

Technical data residual current monitor RCMA470LY

Insulation coordination acc. to IEC 60664-1		Switching elements	
Rated insulation voltage	AC 250 V	Number of switching elements	2 x 1 changeover contact
Rated impulse voltage / pollution degree	4 kV / 3	Operating principle, adjustable	N / C operation / N / O operation
Voltage ranges		Electrical endurance, number of cycles	12000
Supply voltage U_s	see ordering information	Rated contact voltage	AC 250 V / DC 300 V
Operating range of U_s	0.85...1.1 x U_s	Limited making capacity	AC / DC 5 A
Frequency range of U_s	DC / 50...60 Hz	Breaking capacity	2 A, AC 230 V, $\cos \phi = 0.4$ 0.2 A, DC 220 V, L / R = 0.04 s
Power consumption	≤ 3.5 VA	Fault memory	ON
Measuring circuit / response values		General data	
External measuring current transformer	W...B series	EMC immunity	acc. to EN 61543
Operating characteristic acc. to IEC 60755	Type B	EMC emission	acc. to EN 61000-6-4
Rated residual operating current $I_{\Delta n2}$ (prewarning)	50 / 100 % of $I_{\Delta n1}$	Shock resistance IEC 60068-2-27 (during operation)	15 g / 11 ms
Response delay t_v	0 / 1 s	Bumping IEC 60068-2-29 (during transport)	40 g / 6 ms
Rated residual operating current $I_{\Delta n1}$ (alarm)	30 mA...3 A	Vibration resistance IEC 60068-2-6 (during operation)	1 g / 10...150 Hz
Response delay t_v , adjustable	0...10 s	Vibration resistance IEC 60068-2-6 (during transport)	2 g / 10...150 Hz
Rated frequency	0...150 Hz	Ambient temperature, during operation	-25 °C...+70 °C
Relative percentage error	0...-25 %	Ambient temperature, when stored	-40 °C...+75 °C
Hysteresis	approx. 25 % of the response value	Climatic category IEC 60721-3-3	3K5
Response time t_{an} at $I_{\Delta n1} = 1 \times I_{\Delta n1/2}$ ($t_v = 0$ s)	< 70 ms	Operating mode	continuous operation
Response time t_{an} at $I_{\Delta n1} = 5 \times I_{\Delta n1/2}$ ($t_v = 0$ s)	< 40 ms	Mounting	any position
Displays		Connection	screw terminals
LED bar graph indicator	0...100 %	Connection properties	
LEDs	Power On, prewarning, alarm	rigid / flexible	0.2...4 / 0.2...2.5 mm ²
Inputs / outputs		flexible with ferrules without / with plastic collar	0.25...2.5 mm ²
TEST and RESET button	internal / external	Conductor sizes (AWG)	24...12
Cable length external TEST and RESET button	≤ 10 m	Protection class, internal components (IEC 60529)	IP30
Current source for external measuring instrument 0...100 %	DC 0...400 μ A	Protection class, terminals (IEC 60529)	IP20
Load	≤ 12.5 k Ω	Type of enclosure	X470
Cable lengths for measuring current transformers		Enclosure material	polycarbonate
Single wire ≥ 0.75 mm ²	0...10 m	Screw mounting	2 x M4
		DIN rail mounting acc. to	IEC 60715
		Flammability class	UL94V-0
		Standards	IEC 62020
		Instruction leaflet	BP404001
		Weight	≤ 350 g

Ordering information

Type	Response range $I_{\Delta n}$	Rated frequency	Time delay	Measuring current transformers	Fault memory	Indication	Supply voltage U_s	Art. No.
RCMA470LY	30 mA...3 A	0...150 Hz	0...10 s	W35B, W60B	internal / external	×	AC 230 V	B 9404 2001 ²⁾
RCMA470LY-13	30 mA...3 A	0...150 Hz	0...10 s	W35B, W60B	internal / external	×	AC 90...132 V*	B 9404 2003 ²⁾
RCMA470LY-21	30 mA...3 A	0...150 Hz	0...10 s	W35B, W60B	internal / external	×	DC 9.6...84V*	B 9404 2008 ¹⁾
RCMA470LY-23	30 mA...3 A	0...150 Hz	0...10 s	W35B, W60B	internal / external	×	DC 77...286V*	B 9404 2009 ¹⁾

Other supply voltages on request

* Absolute values of the operating range

¹⁾ For industrial application only

²⁾ For industrial and household applications.

Accessories

External measuring current transformers

Type	Inside diameter (mm)	Art. No.
W35B	∅ 35	B 9808 0013
W60B	∅ 60	B 9808 0021






Measuring converter

Type	Input	Output	Art. No.
RK170	0...400 µA	0...10 V / 0/4...20 mA	B 9804 1500

External measuring instrument

Type	Display range	Size (mm)	Art. No.
9604-4241	0...100 %	96 x 96	B 986 807

Conditions of operation according to IEC 62020, IEC 60755 amendment 2, Type B

Type of current	Wave form	Tripping current
Alternating currents (50 Hz)		$0.5...1 \times I_{\Delta n}$
Pulsed DC residual currents (positive and negative half waves) half-wave current		$0.5...1.4 \times I_{\Delta n}$
Phase-controlled half-wave currents Current delay angle 90° el / 135° el		$0.5...1.4 \times I_{\Delta n}$
Half-wave current superimposed by a smooth direct current of 6 mA		$0.5...1.4 \times I_{\Delta n}$
Smooth DC residual current		$0.5...2 \times I_{\Delta n}$

Dimension diagram X470

Dimensions in mm

