

## VARIMETER Voltage relay MK 9064N, MH 9064



### Your Advantages

- Preventive maintenance
- For better productivity
- Quicker fault locating
- Precise and reliable
- Min-, Max. value or window monitoring
- Measuring range up to AC/DC 600 V
- Large measuring ranges
- Simple configuration and fault diagnostic
- Auxiliary voltage ranges DC 24 V, AC 230 V, AC/DC 24 ... 230V or AC/DC 110 ... 400 V


### Features

- According to IEC/EN 60 255-1
- AC/DC voltage measuring (single-phase)
- Start up delay, on delay
- Manual reset
- LCD for indication of the measuring values
- Relay output
  - MK 9064N: 1 changeover contact
  - MH 9064: 2 x 1 changeover contacts
- Relay function selectable (energized/de-energized on trip)
- As option with pluggable terminal blocks for easy exchange of devices
  - with screw terminals
  - or with cage clamp terminals
- Width MK 9064N: 22.5 mm
- Width MH 9064: 45.0 mm

### Product Description

The voltage relays MK 9064N and MH 9064 of the varimeter family provide a solution for an optimised monitoring of the function of an electrical device. Single-phase AC and also DC can be measured, undervoltage, overvoltage and voltage window are monitored and the measured value is displayed on the front.

### Function Diagram

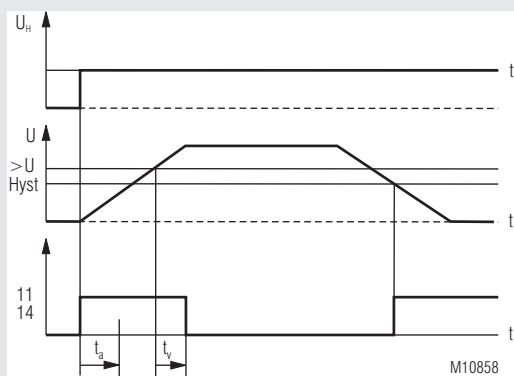

Example: overvoltage monitoring with closed circuit operation

### More Information

- **MH 9064**  
The MH 9064 has 2 relay outputs.  
The voltage monitoring can be assigned to relay 1 and /or relay 2


### Approvals and Markings



### Applications

- Voltage monitoring AC/DC single-phase
- Voltage dependent switching at under- or overvoltage

### Circuit Diagrams

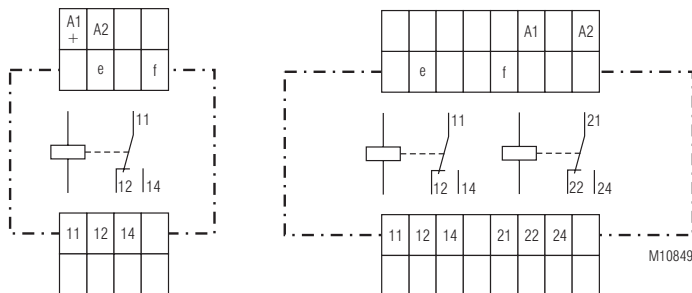

MK 9064N.11

MH 9064.12

### Connection Terminals

| Terminal designation | Signal description             |
|----------------------|--------------------------------|
| A1(+), A2            | Auxiliary voltage AC or DC     |
| e, f                 | Voltage measuring input AC, DC |
| 11, 12, 14           | Indicator relay (C/O contact)  |
| 21, 22, 24           | Indicator relay (C/O contact)  |

## Function


The Device is programmable for AC- or DC- measuring.  
 On AC-measurement the rectified mean value is measured.  
 On sinusoidal input signals the RMS value is displayed.

After connecting the auxiliary supply to terminals A1-A2 the startup delay disables the monitoring function so that changes on the input have no influence on the relay output of the VARIMETER.

The device is in display (RUN) mode and continuously measures the actual values. Pressing **Esc** for more than 3 sec starts the input mode.

If the setting value is exceeded the relay switches and the display indicates this state. The display is inverted, flashes and shows the error.

The fault memory is selectable


With button  the fault memory can be deleted.

On the unit MH 9064it is possible to assign different functions to the different relays so one can be used as pre-warning and the other as alarm output. Relay output 1 switches when actual value exceeds the pre-warning setting. If a second setting assigned to relay output 2 the unit gives an Alarm signal.

## Functional Notes

The unit needs a connected auxiliary supply.  
 It is designed for single phase AC/DC measurement.

## Setting

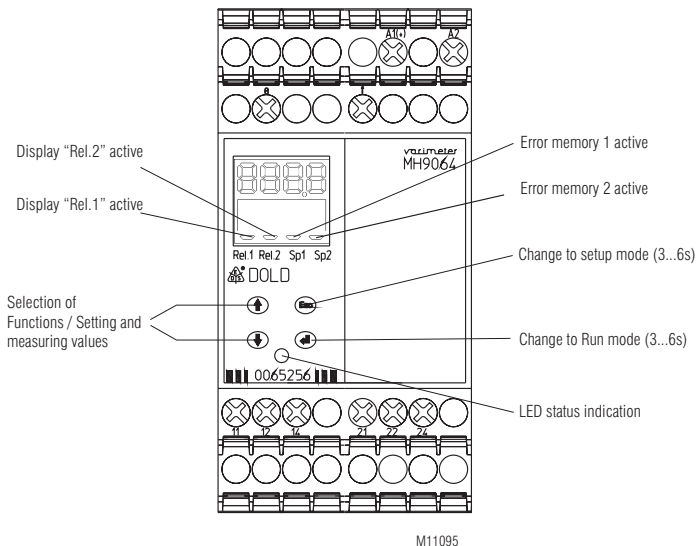


## Indicators

The LED indicate the state.

- green: on, when auxiliary voltage present
- orange (flashes): No measurement; unit in input mode
- red (short On, short Off): Failure overvoltage

**If the measured value is higher then the upper end of scale value, the display shows the fault message "OL"**

## Cursor LCD Display

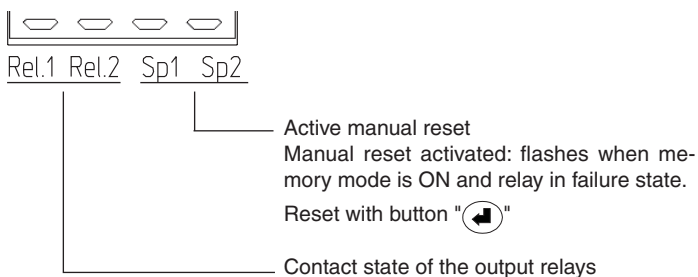

## Operating

### Display (Run) - Mode

### Input-Mode

#### ⬆️ UP / ⬇️ DOWN

After power up the relay is in display (Run) mode.

⬆️ ⬇️ buttons have no function

The measurement is interrupted, the relays are in failure state and the indicator LED has orange color

⬆️ ⬇️ Selection of parameters and setting of thresholds

#### ⬅️ ENTER

Manual reset, when manual reset is selected for output relay  
Reset works only when fault is removed

- Shifts cursor to the right  
- Saves the value no-voltage safe  
- Pressing for more than 3 sec: Change to display (Run) mode.

#### Ⓜ️ Esc

- Pressing for more than 3 sec: Change to input mode

- Shifts cursor to the left  
- Leave setting without saving

## LCD-Display



## Setting Parameter

- < U Fault, when value drops under set point
- > U Fault, when value exceeds set point
- OFF Measurement disabled

If the adjusted threshold of at least one measuring function is exceeded, the corresponding relay output switches after the selected time delay  $t_v$  and the fault is indicated on the display.

Manual reset can be activated or de-activated and is operated with ⬅️ on the unit.

### Adjustable Parameter

Limit values for Rel.1 and Rel.2  
Selectable with buttons ⬆️ ⬇️.

Factory setting

| Parameter | Description                                      | Factory setting |
|-----------|--|-----------------|
| <U:       | Response value undervoltage (Undervoltage relay) | OFF             |
| >U:       | Response value overvoltage,, (Overvoltage relay) | *               |
| Hyst:     | response value hysteresis                        | 5 %             |
| $t_v$ :   | On delay for relays ( 0 ... 10 sec )             | 0 s             |
| A / R:    | Setting open- / closed circuit operation         | R               |
| Sp:       | Error storage ( ON / OFF )                       | OFF             |

Response values can be deactivated. (OFF)

\*) dependent to device-variant (measuring range)

### Further Setting Parameter

Selectable with buttons ⬆️ ⬇️.

Factory setting

| Parameter | Description   | Factory setting |
|-----------|---|-----------------|
| $t_s$ :   | Start up delay, when auxiliary voltage connected ( 0.2 ... 10 s ) | 0.2 s           |
| AC/DC     | Measuring voltage AC or DC  | AC              |

### Restore Factory Settings


(Restore factory settings)

Before auxiliary voltage connected press button Ⓜ️ .  
During start press and hold.

### Indicator output

The switching mode energized or de-energized on trip can be set in input mode. The MH 9064 has 2 relay outputs. Monitoring function can be assigned to Relay 1 and/or to Relay 2.

## Operating

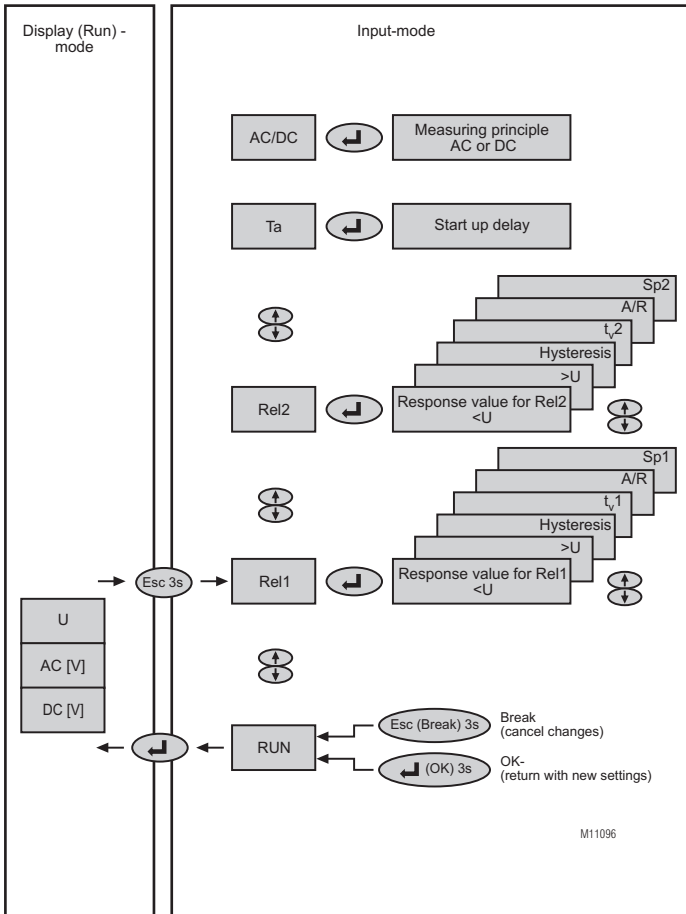

After connecting the auxiliary supply A1/A2 the unit is in display (Run) mode:

The actual measured value is displayed continuously (AC or DC)  
The display is inverted when a measured value is exceeds the settings..

With button the fault memory is reset.

Pressing button **Esc** for more than 3 sec the unit changes to input mode.

In input mode the measurement is disabled, the relays are in failure mode and the indicator LED is orange.

With the buttons the different setting values can be chosen.

Move cursor position

One character to the right

**Esc** One character to the left

### Back to the Display (Run)-Mode

Press button 3 s      **OK**      New values stored

or

Press button **Esc** 3 s;      **Break**      Values unchanged

**RUN** on the display confirm with to change to display (Run) mode.

| Display (Run) - Modus                                       | Input-Mode   |
|---|--|
| Display inverted when the actual value is in failure state. | Measurement interrupted, relays are in failure state, indicator LED orange color   |
| no function   | Chose Rel1, Rel2, T <sub>a</sub> , AC/DC and RUN<br>Chose parameter<br>Change and set response values for Rel1 and Rel2. |
| Reset fault memory:   | <b>Esc</b> Shift cursor to the left<br>Shift cursor to the right   |
| <b>Esc</b> For more the 3 sec, change to input mode         | For more than 3 sec, change to display mode  |

| Technical Data  |   |
|---|---|
| <b>Auxiliary voltage A1/A2</b>  |   |
| <b>Nominal auxiliary voltage U<sub>H</sub></b>  |   |
| MK 9064N, MH 9064:  | DC 24 V (0,9 ... 1,1 x U <sub>H</sub> )   |
| MH 9064:  | AC 230 V (0,8 ... 1,1 x U <sub>H</sub> )  |
|   | AC/DC 24 ... 230 V (0,8 ... 1,1 x U <sub>H</sub> )<br>(on request)                                |
|   | AC/DC 110 ... 400 V (0,8 ... 1,1 x U <sub>H</sub> )   |
| <b>Nominal frequency:</b>   | 50 / 60 Hz  |
| <b>Frequency range:</b>   | 45 ... 400 Hz   |
| <b>Input current</b>  |   |
| at DC 24 V:   | 50 mA   |
| at AC 230 V:  | 15 mA   |
| <b>Voltage Measuring Input L+/L-</b>  |   |
| <b>MK 9064N:</b>  |   |
| <b>Nominal voltage:</b>   | AC/DC 150 mV,<br>AC/DC 5, 80, 300 V   |
| <b>Measuring range U<sub>M</sub>:</b>   | AC/DC 6 ... 150 mV,<br>AC/DC 0,2 ... 5, 5 ... 80, 12 ... 300 V<br>(0,8 ... 1,1 x U <sub>M</sub> ) |
| <b>MH 9064:</b>   |   |
| <b>Nominal voltage:</b>   | AC/DC 150 mV,<br>AC/DC 5, 80, 600 V   |
| <b>Measuring range U<sub>M</sub>:</b>   | AC/DC 6 ... 150 mV,<br>AC/DC 0,2 ... 5, 5 ... 80, 24 ... 600 V<br>(0,8 ... 1,1 x U <sub>M</sub> ) |
| <b>Nominal frequency:</b>   | 50 / 60 Hz  |
| <b>Frequency range:</b>   | 10 ... 400 Hz   |
| <b>Setting Range (absolute, via button and LCD-display)</b>   |   |
| <b>Measuring accuracy at nominal frequency</b><br>(in % of setting value): ± 2 % ± 2 Digit            |   |
| <b>Hysteresis</b><br>(in % of setting value): 2 ... 50 %  |   |
| <b>Reaction time:</b> < 350 ms  |   |
| <b>Adjustable on delay (t<sub>o</sub>):</b> 0 ... 10 s (in steps of 0.1 s)                            |   |
| <b>Adjustable start up delay (t<sub>s</sub>):</b> 0.2 ... 10 s (in steps of 0.1 s)                    |   |
| <b>Output Circuit (Rel1: 11/12/14; Rel2: 21/22/24)</b>  |   |
| <b>Contacts:</b>  |   |
| MK 9064N:   | 1 changeover contact  |
| MH 9064:  | 1 changeover contact (Rel1) and<br>1 changeover contact (Rel2)                                    |
| <b>Thermal current I<sub>th</sub>:</b>  | 2 x 4 A   |
| <b>Switching capacity to AC 15</b>  |   |
| NO contacts:  | 3 A / AC 230 V IEC/EN 60 947-5-1  |
| NC contacts:  | 1 A / AC 230 V IEC/EN 60 947-5-1  |
| to DC 13  |   |
| NO contacts:  | 1 A / DC 24 V IEC/EN 60 947-5-1   |
| NC contacts:  | 1 A / DC 24 V IEC/EN 60 947-5-1   |
| <b>Electrical life to AC 15 at 3 A, AC 230 V:</b> 2 x 10 <sup>5</sup> switch. cycl. IEC/EN 60 947-5-1 |   |
| <b>Permissible switching frequency:</b> 1800 / h  |   |
| <b>Short circuit strength</b>   |   |
| <b>Max. fuse rating:</b>  | 4 A gG / gL IEC/EN 60 947-5-1   |
| <b>Mechanical life:</b>   | 30 x 10 <sup>6</sup> switching cycles   |
| <b>General Data</b>   |   |
| <b>Nominal operating mode:</b> continuous operation   |   |
| <b>Temperature range</b>  |   |
| Operation:  | - 20... + 60°C<br>(at range 0 ... - 20°C limited<br>function of the LCD display)                  |
| Storage:  | - 25... + 60°C  |
| <b>Altitude:</b>  | < 2,000 m   |
| <b>Clearance and creepage distance</b>  |   |
| Overvoltage category:   | III   |
| Rated impulse voltage /<br>pollution degree:  | IEC/EN 60 664-1   |
| MK:   |   |
| Aux. voltage / measuring input:   | 4 kV / 2  |
| Aux. voltage / contacts:  | 6 kV / 2  |
| Measuring input / contacts:   | 6 kV / 2  |
| MH:   |   |
| Aux. voltage / measuring input:   | 4 kV / 2 (U <sub>H</sub> = DC 24 V)   |
| Aux. voltage / measuring input:   | 6 kV / 2  |
| Aux. voltage / contacts:  | 6 kV / 2  |
| Measuring input / contacts:   | 6 kV / 2  |
| Contacts 11,12,14 / 21,22,24:   | 4 kV / 2  |

| Technical Data   |  |
|--|--|
| <b>EMC</b>   |  |
| Electrostatic discharge (ESD):   | 8 kV (air) IEC/EN 61 000-4-2   |
| HF irradiation   |  |
| 80 MHz ... 6.0 GHz:  | 20 V / m IEC/EN 61 000-4-3   |
| Damped oscillatory wave<br>immunity test                                 |  |
| Differential mode voltage:   | 1 kV IEC/EN 61 000-4-18  |
| Common mode voltage:   | 2.5 kV IEC/EN 61 000-4-18  |
| Fast transients:   | 2 kV IEC/EN 61 000-4-4   |
| Surge voltage<br>between   |  |
| wires for power supply:  | 1 kV IEC/EN 61 000-4-5   |
| between wire and ground:   | 2 kV IEC/EN 61 000-4-5   |
| HF-wire guided:  | 10 V IEC/EN 61000-4-6  |
| Interference suppression:  | Limit value class A*)<br>*) The device is designed for the usage<br>under industrial conditions (Class A,<br>EN 55011).<br>When connected to a low voltage public<br>system (Class B, EN 55011) radio inter-<br>ference can be generated. To avoid this,<br>appropriate measures have to be taken. |
| <b>Degree of protection</b>  |  |
| Housing:   | IP 40 DIN EN 60 529  |
| Terminals:   | IP 20 DIN EN 60 529  |
| <b>Housing:</b>  | thermoplastic with VO behaviour<br>according to UL Subject 94  |
| <b>Vibration resistance:</b>   | Amplitude 0.35 mm,<br>frequency 10 ... 55 Hz IEC/EN 60 068-2-6<br>20 / 060 / 04 EN 60 068-1<br>DIN 46 228-1/-2/-3/-4   |
| <b>Climate resistance:</b>   |  |
| <b>Wire connection</b>   |  |
| <b>Screw terminal (fixed):</b>   | 1 x 4 mm <sup>2</sup> solid or<br>1 x 2.5 mm <sup>2</sup> stranded ferruled (isolated) or<br>2 x 1.5 mm <sup>2</sup> stranded ferruled (isolated) or<br>2 x 2.5 mm <sup>2</sup> solid  |
| Insulation of wires or<br>sleeve length:                                 | 8 mm   |
| <b>Terminal block with screw terminals</b>                               |  |
| Max. cross section:  | 1 x 2.5 mm <sup>2</sup> solid or<br>1 x 2.5 mm <sup>2</sup> stranded ferruled (isolated)   |
| Insulation of wires or<br>sleeve length:                                 | 8 mm   |
| <b>Terminal block with cage clamp terminals</b>                          |  |
| Max. cross section:  | 1 x 4 mm <sup>2</sup> solid or<br>1 x 2.5 mm <sup>2</sup> stranded ferruled (isolated)   |
| Min. cross section:  | 0.5 mm <sup>2</sup>  |
| Insulation of wires or<br>sleeve length:                                 | 12 ±0.5 mm   |
| <b>Wire fixing:</b>  | Plus-minus terminal screws M3,5 box<br>terminals with wire protection<br>or cage clamp terminals   |
| <b>Fixing torque:</b>  | 0.8 Nm   |
| <b>Mounting:</b>   | DIN rail EN 60 715   |
| <b>Weight:</b>   |  |
| MK 9064N:  | approx. 140 g  |
| MH 9064:   | approx. 250 g  |
| <b>Dimensions</b>  |  |
| <b>Width x height x depth:</b>   |  |
| MK 9064N:  | 22.5 x 90 x 99 mm  |
| MH 9064:   | 45 x 90 x 99 mm  |
| <b>Classification to DIN EN 50155</b>                                    |  |
| <b>Vibration and shock resistance:</b> Category 1, Class B IEC/EN 61 373 |  |
| Ambient temperature:   | T1 compliant<br>T2, T3 and TX with operational limitations   |
| <b>Protective coating of the PCB:</b> No                                 |  |

## Standard Types

MK 9064N.11 AC/DC 12 ... 300 V DC 24 V


- Article number: 0065254
- Measuring range: AC/DC 12 ... 300 V
  - Auxiliary voltage  $U_H$ : DC 24 V
  - Output: 1 changeover contact
  - Width: 22.5 mm

MH 9064.12 AC/DC 24 ... 600 V AC/DC 110 ... 400 V


- Article number: 0065256
- Measuring range: AC/DC 24 ... 600 V
  - Auxiliary voltage  $U_H$ : AC/DC 110 ... 400 V
  - Output: 1 changeover contact (Rel1) and 1 changeover contact (Rel2)
  - Width: 45 mm

## Ordering Example


MK 9064N .11 AC/DC 12 ... 300 V DC 24 V

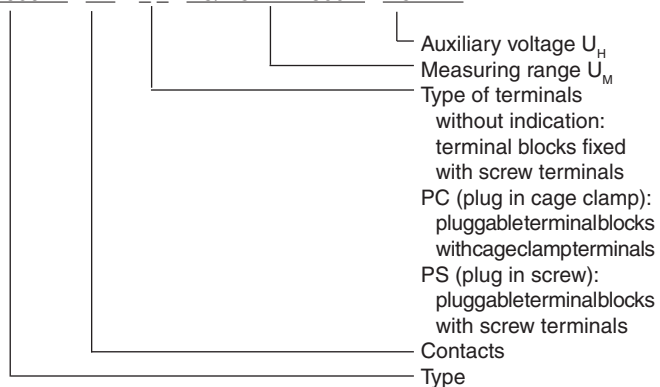

## Options with Pluggable Terminal Blocks



Screw terminal  
(PS/plugin screw)




Cage clamp terminal  
(PC/plugin cage clamp)

## Notes

Removing the terminal blocks with cage clamp terminals

1. The unit has to be disconnected.
2. Insert a screwdriver in the side recess of the front plate.
3. Turn the screwdriver to the right and left.
4. Please note that the terminal blocks have to be mounted on the belonging plug in terminations.

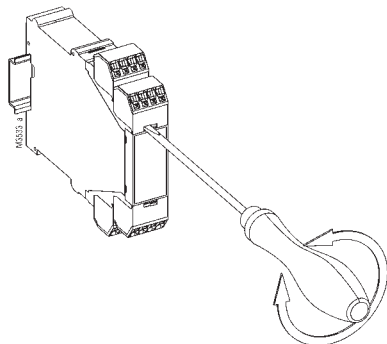

## Set Up Procedure

The connection has to be made according to the connection example.

## Safety Notes



**Dangerous voltage.**  
Electric shock will result in death or serious injury.



Disconnect all power supplies before servicing equipment.

- Faults must only be removed when the relay is disconnected
- The user has to make sure that the device and corresponding components are installed and wired according to the local rules and law (TUEV, VDE, Health and safety).
- Settings must only be changed by trained staff taking into account the safety regulations. Installation work must only be done when power is disconnected.
- Observe proper grounding of all components

## Connection Examples

