



Level



Pressure



Flow



Temperature

Liquid  
Analysis

Registration

Systems  
Components

Services



Solutions

## Technical Information

# Ceraphant T PTC31, PTP31, PTP35

Process pressure

Pressure switch for safe measurement and monitoring of absolute and gauge pressures



### Application

Pressure switch for monitoring absolute and gauge pressures in gases, vapours, liquids and dust.

Ceraphant T PTC31

– with ceramic process isolating diaphragm;

Ceraphant T PTP31

– with metallic process isolating diaphragm;

Ceraphant T PTP35

– for hygienic applications

- Finely graduated measuring ranges from vacuum to 400 bar (6000 psi)
- Versions for use in hygienic applications
- Electronic versions
  - one PNP switch output
  - two PNP switch outputs
  - PNP switch output with additional analog output 4...20 mA (active)

### Your benefits

This compact pressure switch impresses with the latest in technology being used:

- Integrated switching electronics for decentral and economic process monitoring and control.
- Quick and flexible process integration thanks to modular connections.
- High reproducibility and long-term stability.
- Function check and information on site thanks to LEDs and digital display.
- Ceraphire® process isolating diaphragm: corrosion-proof, abrasion-proof and extremely overload-resistant.
- Excellent accuracy and briefest response time right to the smallest measuring range.
- Operation and visualisation also with personal computer and ReadWin® 2000 or FieldCare®.
- Upper part of housing can be rotated by 310°, therefore best readability of measured values in all orientations
- DESINA compliant
- 3A approved






## Table of contents

<b>Function and system design</b> .....	<b>3</b>	metallic process isolating diaphragm .....	13
Device selection .....	3	Process connection PTP31	
Measuring principle .....	3	Thread connections .....	13
Measuring system .....	4	Process connection PTP31	
<b>Input</b> .....	<b>4</b>	Flush-mounted nozzle .....	14
Measured variable .....	4	Process connection PTP35	
Measuring range .....	4	Hygiene connections .....	14
<b>Output</b> .....	<b>4</b>	Process connection PTP35	
Output signal .....	4	Clamp connections .....	15
Range of adjustment .....	5	PTP31 with 400 bar (6000 psi) sensor .....	15
Switching capacity .....	5	Weight .....	15
Inductive load .....	5	Material .....	15
Signal on alarm .....	5	<b>Human interface</b> .....	<b>16</b>
Load .....	5	Operating elements .....	16
<b>Power supply</b> .....	<b>6</b>	On-site operation .....	16
Electrical connection .....	6	Operation with PC .....	19
Supply voltage .....	7	<b>Certificates and approvals</b> .....	<b>20</b>
Current consumption .....	7	CE mark .....	20
Power supply failure .....	7	UL listing .....	20
<b>Performance characteristics</b> .....	<b>8</b>	Pressure Equipment Directive (PED) .....	20
Reference operating conditions .....	8	Suitability for hygienic processes .....	20
Switch output .....	8	Standards and guidelines .....	20
Analog output .....	8	<b>Ordering Information</b> .....	<b>21</b>
Influences of air pressure changes .....	8	Ceraphant T PTC31 .....	21
Long-term drift .....	8	Ceraphant T PTP31 .....	23
Long-term reliability .....	8	Ceraphant T PTP35 .....	25
Thermal change .....	8	Questionnaire on customer-specific configuration .....	27
<b>Operating conditions (installation)</b> .....	<b>9</b>	<b>Accessories</b> .....	<b>28</b>
Installation instructions .....	9	Welding boss	
Oxygen applications .....	9	– with sealing taper .....	28
<b>Operating conditions (environment)</b> .....	<b>9</b>	Welding boss	
Ambient temperature range .....	9	– with sealing surface .....	28
Storage temperature .....	9	Thread adapter .....	28
Degree of protection .....	9	Clamp adapter .....	28
Shock resistance .....	9	Hygiene adapter .....	29
Vibration resistance .....	9	Plug-in jack .....	29
Electromagnetic compatibility .....	9	Connecting cable .....	29
<b>Operating conditions (Process)</b> .....	<b>10</b>	Configuration kit .....	30
Medium temperature range .....	10	Power supply RNB130 .....	30
Limiting medium pressure range .....	10	<b>Documentation</b> .....	<b>31</b>
Pressure specifications .....	10	Field of Activities .....	31
<b>Mechanical construction</b> .....	<b>11</b>	Technical Information .....	31
Design, dimensions .....	11	Operating instructions .....	31
Process connection PTC31			
Sensor module with ceramic process isolating diaphragm .....	12		
Process connection PTP			
Sensor module with			

## Function and system design

### Device selection

Ceraphant T - product family	PTC31	PTP31	PTP35
	 P01-PTC31xxx-14-xx-xx-xx-001	 P01-PTP31xxx-14-xx-xx-xx-001	 P01-PTP35xxx-14-xx-xx-xx-001
Measuring cell	With capacitive measuring cell and ceramic process isolating diaphragm (Ceraphire®)	With piezoresistive measuring cell and metallic process isolating diaphragm	With piezoresistive measuring cell and metallic process isolating diaphragm for hygienic applications
Field of application	Measurement and monitoring of absolute and gauge pressures	Measurement and monitoring of absolute and gauge pressures	Measurement and monitoring of absolute and gauge pressures in hygienic processes
Process connection	Thread – G ¼ female – G ¼A and G ½A – G ½A, hole 11 mm – M 12x1,5 – 7/16-20 UNF – ¼ FNPT and ½ MNPT	Thread – G ¼ female – G ¼A and G ½A – G ½A, hole 11 mm – M 12x1,5 – 7/16-20 UNF – ¼ FNPT and ½ MNPT – G ½A flush mounted	Hygiene – Clamp ½" - 2" – G 1A – Varivent F, N – DIN 11851 – APV inline – SMS 1½"
Measuring range	0 to 0.1 bar (1.5 psi) to 0 to 40 bar (600 psi)	0 to 1 bar (15 psi) to 0 to 400 bar (6000 psi)	0 to 1 bar (15 psi) to 0 to 40 bar (600 psi)
Process temperature	–40°C to +100°C (–40°F to +212°F)	–40°C to +100°C (–40°F to +212°F)	–40°C to +100°C (–40 °F to +212 °F) 135°C (275°F) max. 1 hour

### Measuring principle

#### Ceraphant T PTC31

The process pressure acts on the ceramic process isolating diaphragm and the pressure-dependent change in capacitance of the ceramic sensor is measured. A microprocessor evaluates the signal and switches the output or outputs the corresponding measured value.


The ceramic sensor is a dry sensor i.e. no fill fluid is needed for pressure transmission. This means that the sensor can fully support a vacuum. Extremely high durability, on a par with the material Alloy, is achieved through the use of the highly pure material Ceraphire® as a ceramic.

#### Ceraphant T PTP31 and PTP35

The process pressure acting upon the metallic process isolating diaphragm of the sensor is transmitted to a resistance bridge via a fluid. The change in the output voltage of the bridge is proportional to the pressure and can be measured directly.

**Measuring system****DC voltage version**

Positive signal at electronics switch output (PNP). Power supply, e.g. with a transmitter power supply unit. Preferred in conjunction with programmable logic controllers (PLC) or to control relays.

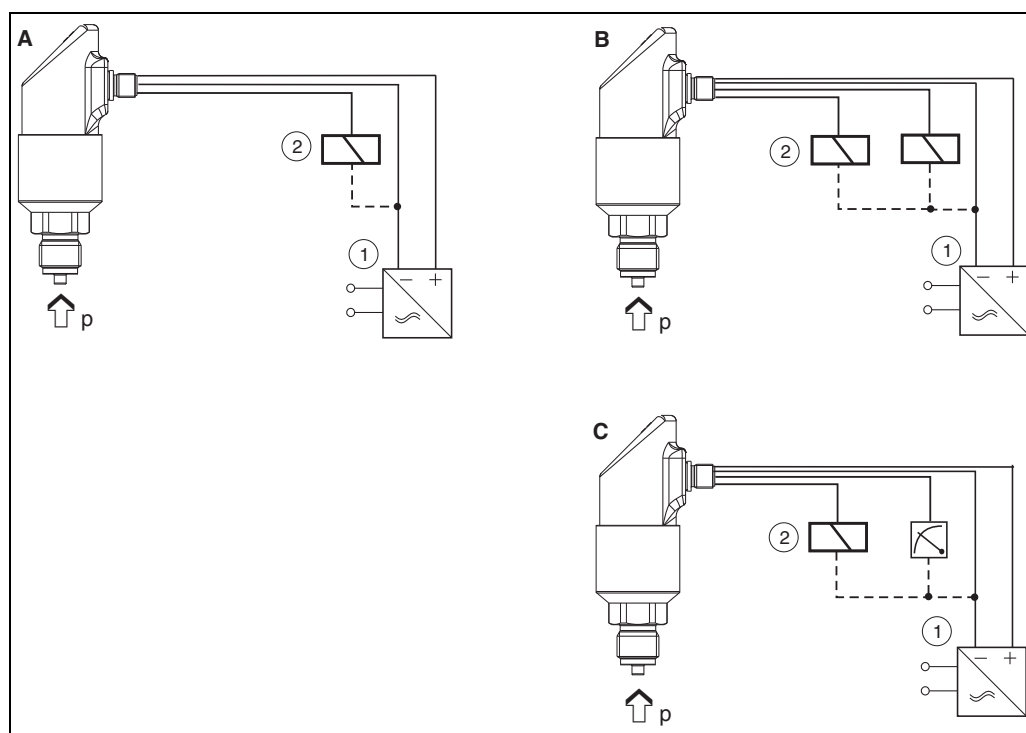

A: 1x PNP switch output

B: 2x PNP switch output

C: PNP switch output with additional analog output 4...20 mA (active).

① Transmitter power supply unit

② Load (e.g. programmable logic controller, process control system, relay)

**Input****Measured variable**

The measured variable for the pressure switch can be selected as either gauge pressure or absolute pressure.

**Measuring range**

Measuring ranges up to 400 bar (6000 psi), see "Ordering information" section.

**Output****Output signal**

DC voltage version: Positive voltage signal (rate depends on power supply voltage) at electronics switch output (PNP). Short-circuit proof version.

- 1x PNP switch output
- 2x PNP switch output
- PNP switch output with additional active analog output 4...20 mA.

The analog output continuously represents the measuring range configured or specified by the sensor.

---


<b>Range of adjustment</b>	<ul style="list-style-type: none"><li>■ Switch output: Switch point (SP): 0.5...100 % in increments of 0.1 % (min. 1 mbar * (0.015 psi)) of the upper range limit (URL) Switch-back point (RSP): 0...99.5 % in increments of 0.1 % (min. 1 mbar * (0.015 psi)) of the upper range limit (URL) Min. distance between SP and RSP: 0.5% URL * measuring ranges with negative gauge pressure up to 4 bar (60 psi) in increments of min. 10 mbar (0.15 psi)</li><li>■ Analog output (if available): Lower range value (LRV) and upper range value (URV) can be set anywhere within the sensor range (LRL - URL). Turn down of the analog output up to 4:1 of the upper range limit (URL).</li><li>■ Damping: can be set anywhere between 0...40 s in increments of 0.1 s</li><li>■ Factory setting (if no customer-specific settings have been ordered): Switch point SP 1: 45 %; Switch-back point RSP 1: 44.5 % Switch point SP 2: 55 %; Switch-back point RSP 2: 54.5 % Analog output: LRV 0 %; URV 100 %</li></ul> <p>LRL = Lower Range Limit / URL = Upper Range Limit LRV = Lower Range Value / URV = Upper Range Value</p>
<b>Switching capacity</b>	DC voltage version: <ul style="list-style-type: none"><li>■ Switch status ON: <math>I_a \leq 250</math> mA, switch status OFF: <math>I_a \leq 1</math> mA</li><li>■ Switching cycles: &gt;10,000,000</li><li>■ Voltage drop PNP: <math>\leq 2</math> V</li><li>■ Overload resistance: Automatic load check of switching current; max. capacitance load: 14 <math>\mu</math>F at max. supply voltage (without resistive load) max. period length: 0.5 s; min. <math>t_{on}</math>: 40 <math>\mu</math>s Periodic disconnection from a protective circuit in event of overcurrent (<math>f = 2</math> Hz) and indication of "Warning"</li></ul>
<b>Inductive load</b>	To prevent electrical interference, only operate an inductive load (relays, contactors, solenoid valves) when directly connected to a protective circuit (free-wheeling diode or capacitor).
<b>Signal on alarm</b>	<ul style="list-style-type: none"><li>■ Analog output <math>\leq 3,6</math> mA / last current value / <math>\geq 21,0</math> mA adjustable (if setting <math>\geq 21.0</math> mA the output is <math>\geq 21.5</math> mA)</li><li>■ Switch outputs: In safe state (switch normally open)</li></ul>
<b>Load</b>	Max. $(V_{Supply} - 6.5 \text{ V}) / 0.22 \text{ A}$ (analog output)

---

# Power supply

## Electrical connection


## Connector and cable connection

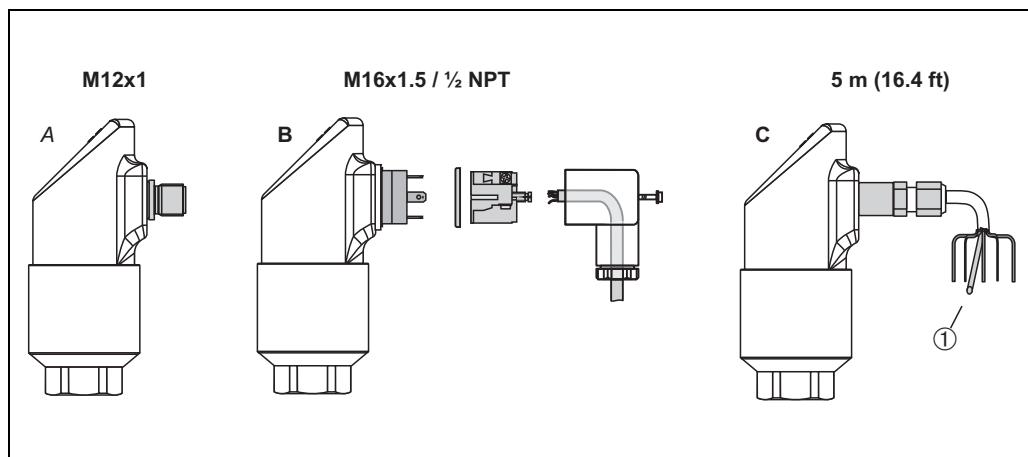

A: M 12x1 connector;  
 B: M 16x1.5 or 1/2 NPT valve plug  
 C: cable, 5 m (16.4 ft) long, 5-core  
 ① reference pressure supply


## Device connection

- DC voltage version with M 12x1 connector

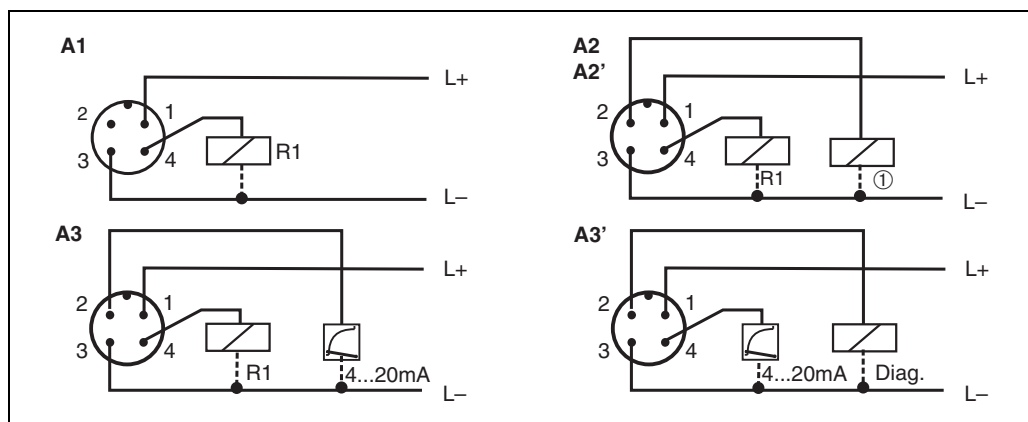


A1: 1x PNP switch output  
 A2: PNP switch outputs R1 and ① (R2)  
 A2': PNP switch outputs R1 and ① (diagnosis/break contact with adjustment "DESINA")  
 A3: PNP switch output with additional analog output  
 A3': PNP switch output with additional analog output (PIN assignment with "DESINA" setting)

- DC voltage version with M 16x1.5 or 1/2 NPT valve plug

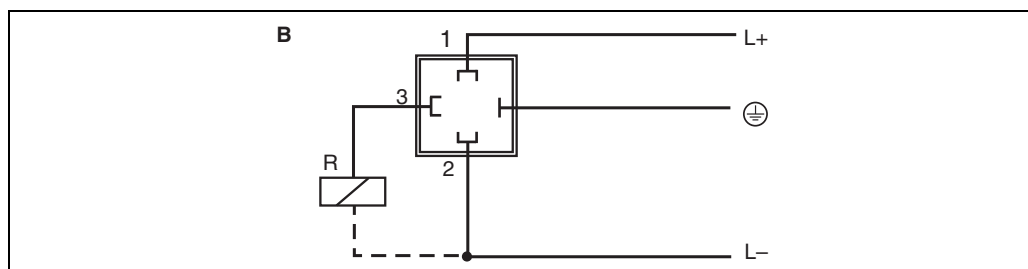

B: 1x PNP switch output

■ DC voltage version with cable

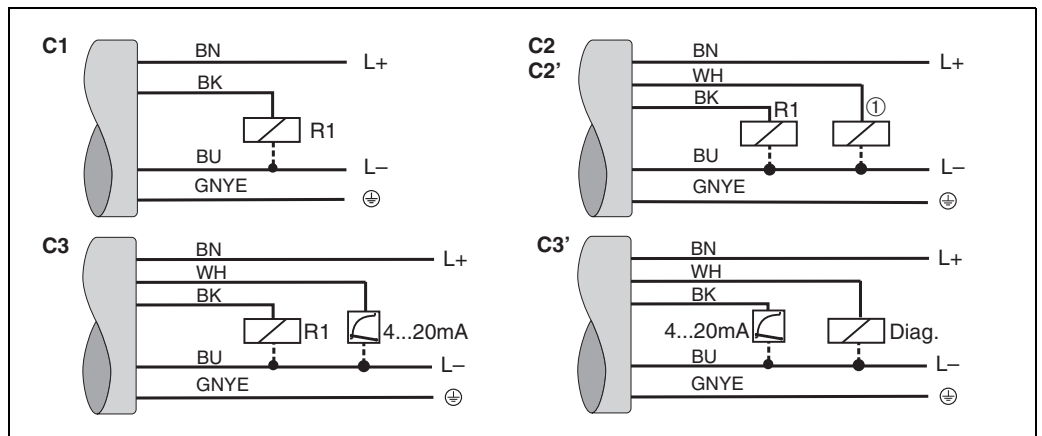

C1: 1x PNP switch output

C2: 2x PNP switch output

C2': PNP switch outputs R1 and ① (diagnosis/break contact with adjustment "DESINA")

C3: PNP switch output with additional analog output

C3': PNP switch output with additional analog output (assignment with "DESINA" setting)

Cable specification: all three connection versions 5-core; 4 x 0.2 mm<sup>2</sup> (AWG25), PE 0.75 mm<sup>2</sup> (AWG18)

– Core colours: BN = brown, BK = black, WH = white, BU = blue, GNYE = green/yellow

**Supply voltage**

- DC voltage version  
12...30 V DC

**Current consumption**

Without load < 60 mA, with reverse polarity protection

**Power supply failure**

- Behaviour in case of overvoltage (>30 V)  
The device works continuously without any damage up to 34 V DC.  
The specific properties are no longer guaranteed if the supply voltage is exceeded.  
No damage is caused to the device in case of a short-term overvoltage up to 1 kV (as per EN 6100-4-5)
- Behaviour in case of undervoltage  
If the supply voltage drops below the minimum value, the device switches off (status as if not supplied with power = switch open).

## Performance characteristics

The percentage information in the "Performance characteristics" section refer to the upper range limit (URL).

<b>Reference operating conditions</b>	To DIN IEC 60770 or DIN IEC 61003 T = 25 C (77 °F), relative humidity 45 to 75 %, ambient air pressure 860 to 1060 hPa
<b>Switch output</b>	<ul style="list-style-type: none"> <li>■ Accuracy: deviation &lt;0.5 %</li> <li>■ Non-repeatability: &lt;0.2 %</li> <li>■ Response time: ≤20 ms</li> </ul>
<b>Analog output</b>	<ul style="list-style-type: none"> <li>■ Maximum measured error: Non-linearity + hysteresis + non-repeatability: ≤0.5 % (as per limit point method)</li> <li>■ Non-linearity: ≤0.2 % (as per limit point method)</li> <li>■ Rise time T<sub>90</sub>: ≤200 ms</li> <li>■ Settling time T<sub>99</sub>: ≤400 ms</li> </ul>
<b>Influences of air pressure changes</b>	In the case of air pressure changes the following additional measuring errors might occur: 400 bar (6000 psi): max. 0.0275 % 100 bar (1500 psi): max. 0.1 % 40 bar (600 psi): max. 0.275% 10 bar (150psi): max. 1 %
<b>Long-term drift</b>	≤0.15 % per year
<b>Long-term reliability</b>	Mean time between failure (MTBF) > 100 years (calculated according to "British Telecom Handbook of Reliability Data No. 5)
<b>Thermal change</b>	<ul style="list-style-type: none"> <li>≤ ± 1.5 % (-20 to +45°C (-4 to +113°F))</li> <li>≤ ± 2.0 % (-40 to +85°C (-40 to +185°F))</li> <li>≤ ± 2.5 % (-40 to +100°C (-40 to +212°F))</li> </ul>



## Operating conditions (installation)

### Installation instructions

- Any orientation
- Any position-dependent zero shift can be corrected. Offset:  $\pm 20$  % URL
- Housing can be rotated up to  $310^\circ$

### Oxygen applications

Oxygen and other gases can react explosively to oils, grease and plastics, such that, among other things, the following precautions must be taken:

- All components of the system, such as measuring devices, must be cleaned in accordance with BAM requirements (DIN 19247). (BAM = Federal Institute for Materials Research and Testing).
- Depending on the materials used, a certain maximum temperature and a maximum pressure must not be exceeded in oxygen applications. The maximum temperature  $T_{\max}$  for oxygen applications is  $60^\circ\text{C}$  ( $140^\circ\text{F}$ ).

The devices suitable for gaseous oxygen applications are listed in the following table, indicated by  $p_{\max}$ .

Order code for devices cleaned for oxygen applications	$p_{\max}$ for oxygen applications
PTC31 – * * * * * 6 *, for devices with sensors, nominal value < 10 bar (150 psi)	Overpressure limit (OPL) of sensor <sup>1)</sup>
PTC31 – * * * * * 6 *, for devices with sensors, nominal value $\geq 10$ bar (150 psi)	30 bar (450 psi)

1) → See Page 21 ff "Ordering information", feature 80 "Sensor seal".

## Operating conditions (environment)

### Ambient temperature range

-40 to  $+85^\circ\text{C}$  (-40 to  $+185^\circ\text{F}$ ), briefly up to  $+100^\circ\text{C}$  ( $212^\circ\text{F}$ )

### Storage temperature

-40 to  $+85^\circ\text{C}$  (-40 to  $185^\circ\text{F}$ )

### Degree of protection

- M 12x1 connector  
Gauge pressure sensors <10 bar (150 psi): IP 60 / sensors for gauge pressure  $\geq 10$  bar (150 psi) and absolute pressure: IP 66
- M 16x1.5 or  $\frac{1}{2}$  NPT valve plug  
Gauge pressure sensors <10 bar (150 psi): IP 60 / sensors for gauge pressure  $\geq 10$  bar (150 psi) and absolute pressure: IP 65
- Cable: IP 66

For applications where the device is installed outdoor or cleaned from outside we recommend the use of a protection cap

### Shock resistance

50 g to DIN IEC 68-2-27 (11 ms)

### Vibration resistance

20 g to DIN IEC 68-2-6 (10-2000Hz)

### Electromagnetic compatibility

- Interference emission as per EN 61326, class B electrical equipment
- Interference immunity as per EN 61326, appendix A (industrial use)

---

## Operating conditions (Process)

---

### Medium temperature range

- PTC31, PTP31:  $-40^{\circ}\text{C} \dots +100^{\circ}\text{C}$  ( $-40^{\circ}\text{F}$  to  $+212^{\circ}\text{F}$ )
- PTP35:  $-40^{\circ}\text{C} \dots +100^{\circ}\text{C}$  ( $-40^{\circ}\text{F}$  to  $+212^{\circ}\text{F}$ ),  $+135^{\circ}\text{C}$  ( $+275^{\circ}\text{F}$ ) for max. 1 hour

Please also note the temperature limits of the seal used (see page 12: Material)

Extreme jumps in temperature can result in temporary errors. Temperature compensation takes effect after several minutes. Internal temperature compensation is faster the smaller the temperature jump and the longer the time interval

---

### Limiting medium pressure range

- For overload resistance see "Ordering information" section
  - Vacuum resistance
    - For ceramic sensor with nominal value  $>100$  mbar (1.5 psi):  $0$  mbar<sub>abs</sub> (0 psi)
    - For ceramic sensor 100 mbar (1.5 psi):  $700$  mbar<sub>abs</sub> (10.5 psi)
    - For metal sensor:  $10$  mbar<sub>abs</sub> (0.15 psi)
- 

### Pressure specifications

The maximum pressure for the measuring device is dependent on the weakest element with regard to pressure, see the following sections "Ordering information: Measuring range" and "Mechanical construction"


The MWP (maximum working pressure) is specified on the nameplate. This value refers to a reference temperature of  $+20^{\circ}\text{C}$  ( $-68^{\circ}\text{F}$ ) and may be applied to the device for an unlimited time.

The test pressure (Over Pressure Limit OPL) corresponds to 1.5 times the MWP and may be applied for a limited time only in order to avoid lasting damage.

## Mechanical construction

### Design, dimensions

### Dimensions

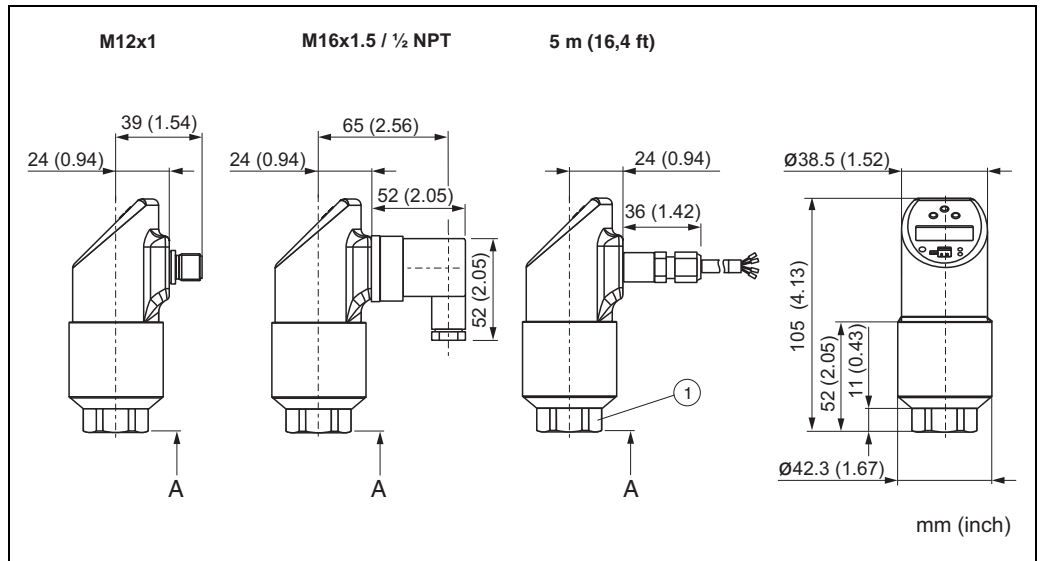

P01-PTx3xxxx-06-xx-xx-xx-001


M 12x1 connector as per IEC 60947-5-2

M 16x1.5 or 1/2 NPT valve plug as per DIN 43650A/ISO 4400

Cable 5 m (16 ft) long, cable outer diameter 7.7 mm (0.3 in); cores 4 x 0.2 mm<sup>2</sup> (AWG 24), PE 0.75 mm<sup>2</sup> (AWG 18) reference pressure hose with outer diameter 2.5 mm (0.1 in)

① Across flats AF 27 mm (for 400 bar (6000 psi) sensor AF 32 mm)  
A = height dimension of process connections – see next diagrams

### Process connection

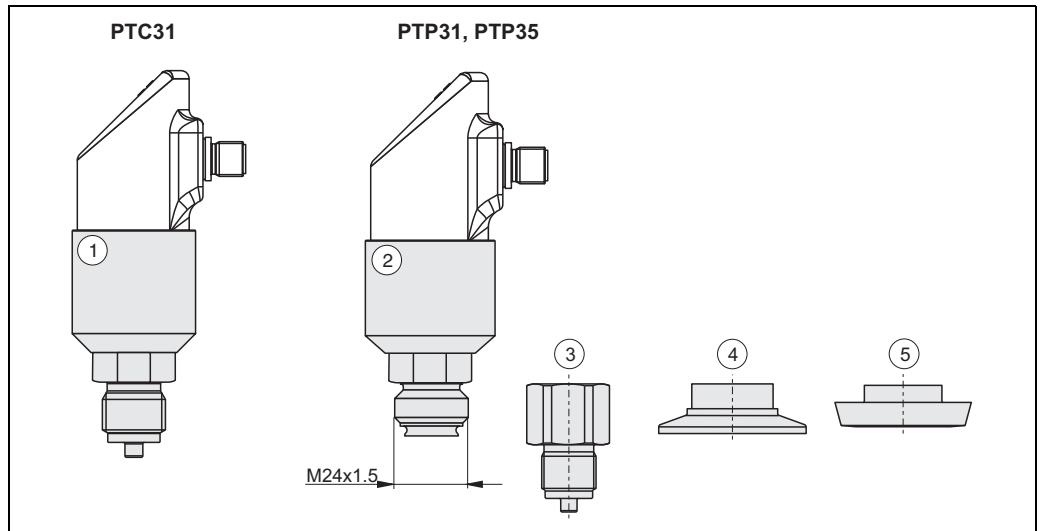

P01-PTx3xxxx-06-xx-xx-xx-006

PTC31: sensor module ① with process connection.

PTP31/35: sensor module ② with M24x1.5 adapter thread for adapters with process connection.


Adapter (mounted onto sensor module at the factory, 400 bar (6000 psi) thread adapter welded onto sensor module)

③ Adapter with thread connection

④ Adapter with clamp connection (except 1/2" clamp)

⑤ Adapter with hygienic connection (except G 1 A)

**Process connection PTC31  
Sensor module with ceramic  
process isolating diaphragm**

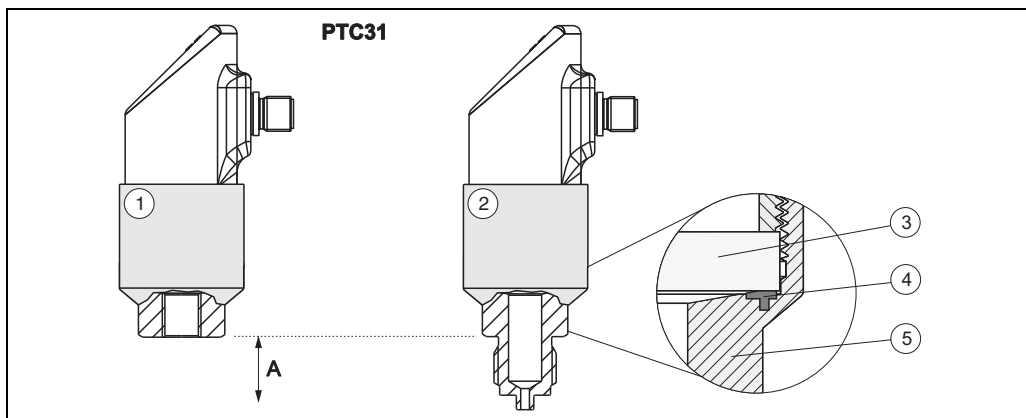

P01-PTx3xxxx-14-xx-xx-xx-003


PTC31; sensor module with process connection

- ① with internal thread
- ② with external thread

"Seal" detail: ③ Ceraphire ceramic sensor, ④ moulded seal, in contact with process, ⑤ sensor module

Dimension A: see the following dimension drawings (dimension with \*)

**Thread connections**

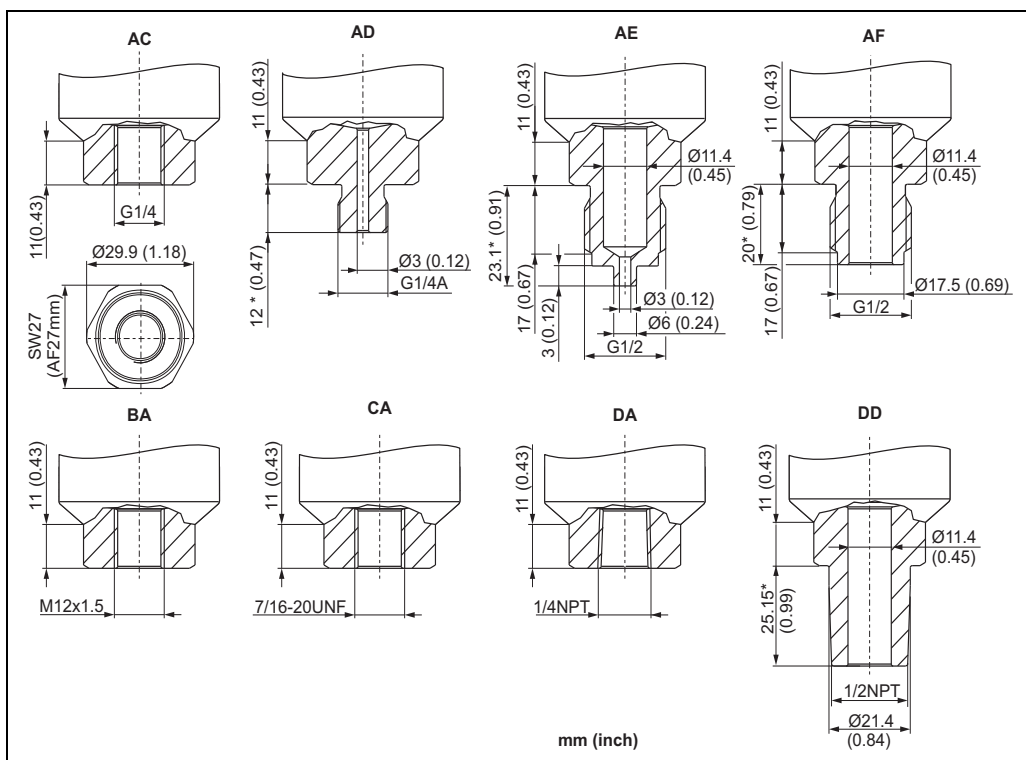


P01-PTx3xxxx-06-xx-xx-xx-002

Process connection versions (see also "Ordering information" section)

- AC: thread ISO 288, G $\frac{1}{4}$  (female)
- AD: thread ISO 288, G $\frac{1}{4}$ A
- AE: thread ISO 288, G $\frac{1}{2}$ A
- AF: thread ISO 288, G $\frac{1}{2}$ A, bore 11 mm (0.43 in)
- BA: Thread DIN 13, M 12x1.5
- CA: thread 7/16-20 UNF (SAE)
- DA: thread ANSI  $\frac{1}{4}$  FNPT
- DD: thread ANSI  $\frac{1}{2}$  MNPT

**Process connection PTP  
Sensor module with  
metallic process isolating  
diaphragm**

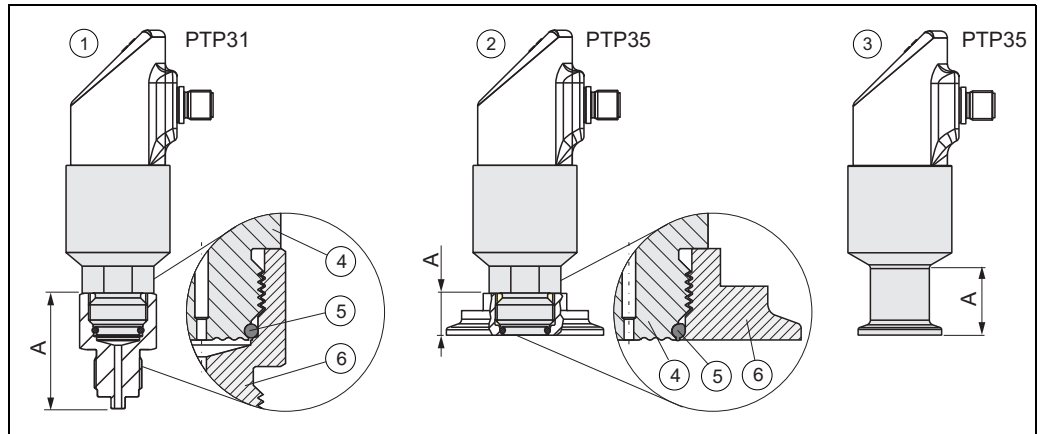


- ① Sensor module with adapter thread for adapters with thread connection
- ② Sensor module with adapter thread for adapters with clamp or hygiene connection
- ③ Sensor module with clamp or hygiene connection (only versions DA, BA, BB)

"Seal" detail: ④ sensor module, ⑤ Standard O-ring, in contact with process, ⑥ adapter


Dimension A: see the following dimension drawing (dimension with \*). For 400 bar (6000 psi) sensor see also Page 12.

**Process connection PTP31  
Thread connections**

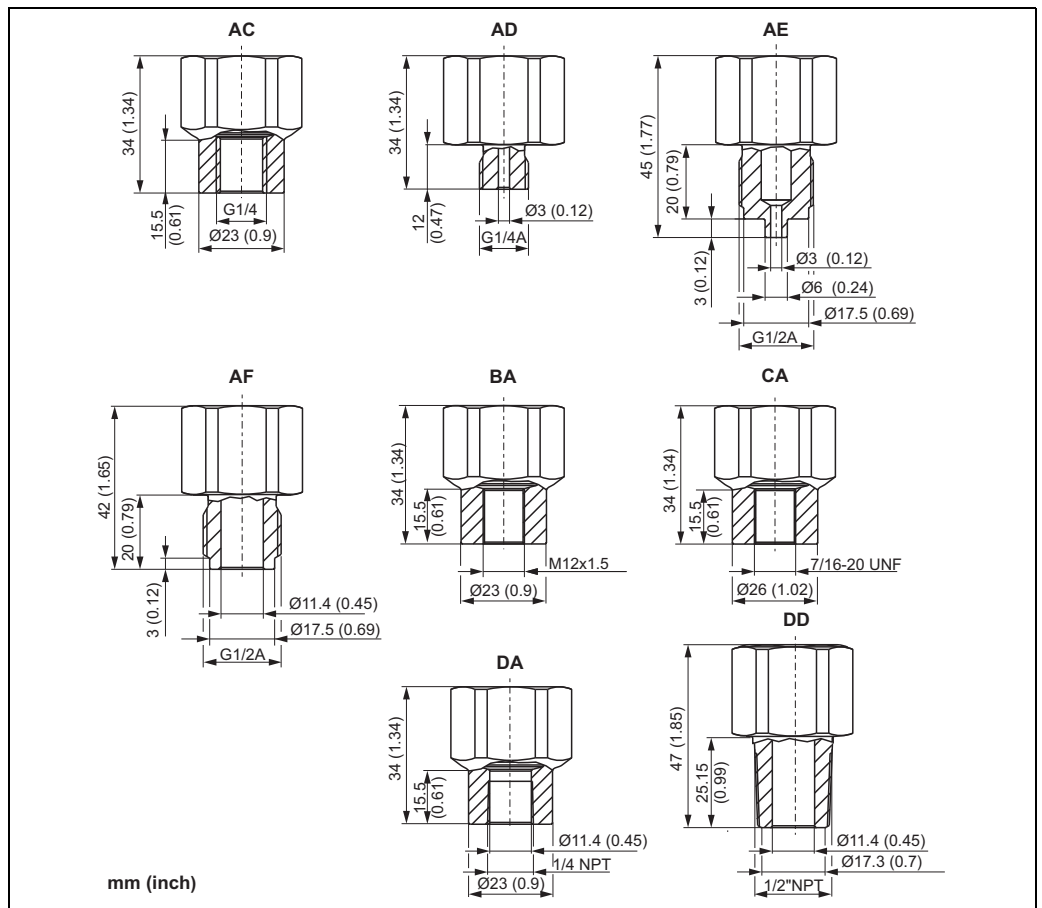

- Process connection versions: sensor module with adapter (see also "Ordering information" section)
- AC: thread ISO 228, G $\frac{1}{4}$  (female)
  - AD: thread ISO 228, G $\frac{1}{4}$ A
  - AE: thread ISO 228, G $\frac{1}{2}$ A
  - AF: thread ISO 228, G $\frac{1}{2}$ A, bore 11 mm (0.43 in)
  - BA: Thread DIN 13, M 12x1.5
  - CA: thread 7/16-20 UNF (SAE)
  - DA: thread ANSI  $\frac{1}{4}$  FNPT
  - DD: thread ANSI  $\frac{1}{2}$  MNPT

**Process connection PTP31  
Flush-mounted nozzle**

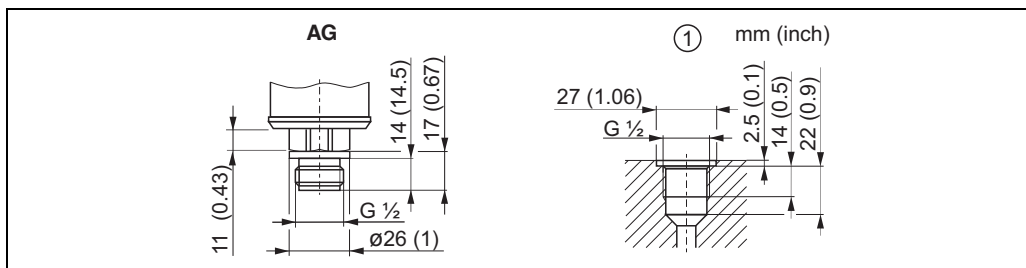


P01-PMP131xx-06-09-xx-xx-002

Process connection PTP31; Version AG

AG: Thread ISO 228 G 1/2, seal DIN 3852 flush-mounted

①: Dimensions for tapped hole G 1/2 as per DIN 3852-11 form X

**Process connection PTP35  
Hygiene connections**

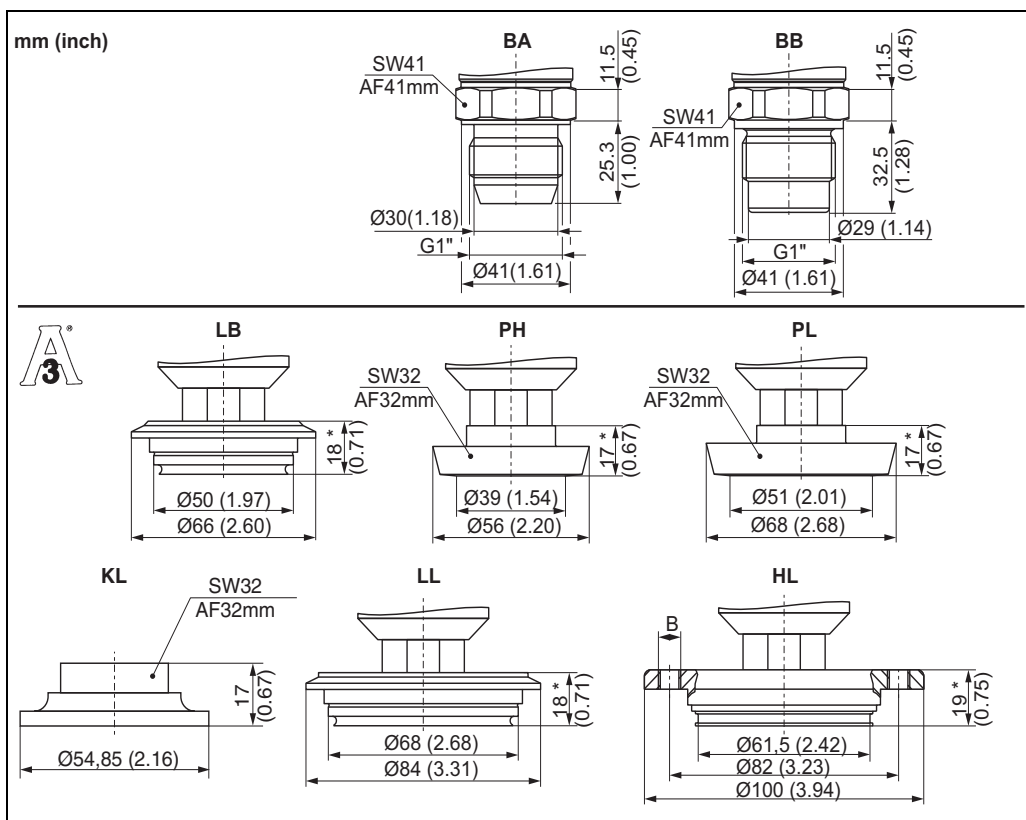

P01-PTX3xxxx-06-xx-xx-xx-004

Process connection versions

BA: thread ISO 228 G1A, metal taper seal

BB: thread ISO 228 G1A, O-ring seat seal

Process connection versions (sensor module with adapter)

LB: Varivent F pipe DN 25-32, PN 40

LL: Varivent N pipe DN 40-162, PN 40

PH: DIN 11851, DN 40, PN 40 (including coupling nut)


PL: DIN 11851, DN 50, PN 25 (including coupling nut)

HL: APV intine, DN 50, PN 40, (B = bores 6 x Ø8.6 + 2 x M8 thread)

KL: SMS 1 1/2 PN 25, 316L, 3A

See also "Ordering information" section

**Process connection PTP35  
Clamp connections**

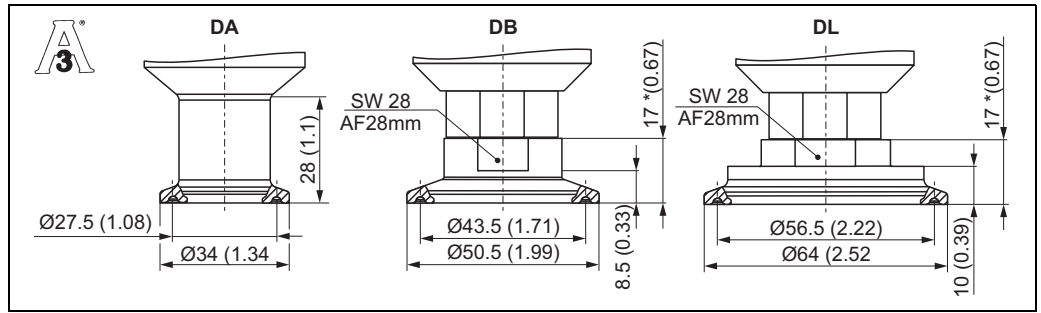

Process connection version

DA: Clamp ISO 2852 DN 22 (¾") or DN 20 (DIN 32676)

Process connection versions (sensor module with adapter)

DB: Tri-Clamp ISO 2852 DN 25...DN 38 (1"...1½") or DN 25...DN 40 (DIN 32676)

DL: Tri-Clamp ISO 2852 DN 40...DN51 (2") or DN 50 (DIN 32676)

See also "Ordering information" section

**PTP31 with 400 bar (6000 psi)  
sensor**

- Across flats on sensor module AF 32 mm
- Sensor module welded to thread adapter
- For ¼ NPT thread connections, M 12x1.5, 7/16-20UNF: dimension A 5 mm (0.2 in) longer
- For ½ NPT thread connections, G ½A: dimension A 1 mm (0.04 in) longer

**Weight**

- PTC31: approx. 0.32 kg (0.71 lbs)
- PTP31: approx. 0.37 kg (0.82 lbs)
- PTP35: approx. 0.58 kg (1.28 lbs) with clamp process connection 1...1½"

**Material**

- Process connection: AISI 316L  
Surfaces in contact with the process for PTP35,  $R_a \leq 0.8 \mu\text{m}$  (31.5  $\mu\text{in}$ )  
Coupling nut: AISI 304
- Process isolating diaphragm for PTC31: Ceraphire® (99.9 %  $\text{Al}_2\text{O}_3$ ), FDA number 21-CFR 186.1256  
Process isolating diaphragm for PTP31/35: AISI 316L
- Filling oil for PTP31 and PTP35: synthetic oil, FDA number 21-CFR 172.882
- Seals:  
FKM: Viton®, temperature range  $-20^\circ\text{C}$  to  $+100^\circ\text{C}$  ( $-4^\circ\text{F}$  to  $+212^\circ\text{F}$ )  
EPDM: FDA number 21-CFR 177.2600, Class II 3A Sanitary Standard 18, USP Class VI, temperature range  $-40^\circ\text{C}$  to  $+100^\circ\text{C}$  ( $-40^\circ\text{F}$  to  $+212^\circ\text{F}$ )  
FKM: Viton® for  $\text{O}_2$  applications (70C3 CO2-70-0041V), temperature range  $-10$  to  $60^\circ\text{C}$  ( $+14$  to  $140^\circ\text{F}$ )
- Housing:  
AISI 316L, with electropolished surface  $R_a \leq 0.8 \mu\text{m}$  (31,5  $\mu\text{in}$ )  
O ring between housing and sensor modul: EPDM
- Electrical connection:  
M12 connector: exterior AISI 316L, interior polyamide (PA)  
Valve plug: outer covering made of polyamide (PA)  
Cable: outer covering made of polyurethane (PUR/UL94, V0, UV-resistant)  
O ring between electrical connection and housing: FKM
- Display:  
Polycarbonate PC-FR (Lexan®)  
Seal between display and housing: SEBS THERMOPLAST K®
- Keys:  
Polycarbonate PC-FR (Lexan®)

**TSE Certificate of Suitability**

The following applies to all process wetted device components:

- They do not contain any materials derived from animals.
- No auxiliaries or operating materials derived from animals are used in production or processing.


Note!

Process wetted device components are listed in the "Mechanical construction" (→ 11) and "Ordering Information" (→ 21) sections.

## Human interface

### Operating elements

Position and meaning of display and operating elements.

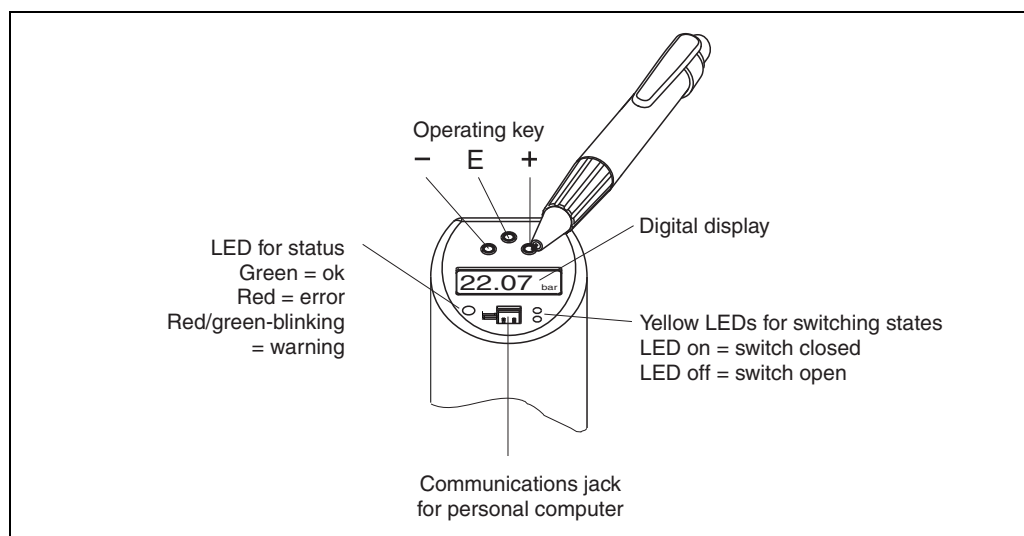

P01-FTX3xxxx-19-xx-xx-en-003

The background illumination of the digital display indicates the status of the device:  
white = ok; red = error

### On-site operation

Menu-guided operation using operating keys.


Function group	Operating options
BASE (basic functions)	Selection of unit: bar, psi, kPa/MPa
	Offset: $\pm 20$ % URL
	Damping display value, output signal: anywhere between 0...40 s (in increments of 0.1 s)
	Display: – Display of measured value or configured switch point – Rotation of display by 180° – Switching off display
	Behaviour according to DESINA: The PIN assignment of the M12 connector is in accordance with the guidelines of DESINA (DESINA = distributed and standardised installation technology for machine tools and manufacturing systems)
OUT (Configuration of 1st output)	Output function: – Hysteresis function or window function – NC contact or NO contact (see next diagram) – Analog output 4...20 mA
	Switch point: – Input value – Acceptance of applied value Switch point anywhere between 0.5...100 % URL (in increments of 0.1 %, min. 0.001 bar (0.015 psi))
	Switch-back point: – Input value – Acceptance of applied value Switch-back point anywhere between 0...99.5 % URL (in increments of 0.1 %, min. 0.001 bar (0.015 psi))
	Switch output delay: anywhere between 0...99 s (in increments of 0.1 s)



Function group	Operating options
OUT 2 (Configuration of 2nd output, only for corresponding electronics version)	Output function: – Hysteresis function or window function – NC contact or NO contact (see next diagram) – Analog output 4...20 mA
	Switch point 2: – Input value – Acceptance of applied value Switch point anywhere between 0.5...100 % URL (in increments of 0.1 %, min. 0.001 bar (0.015 psi))
	Switch-back point 2: – Input value – Acceptance of applied value Switch-back value anywhere between 0...99.5 % URL (in increments of 0.1 %, min. 0.001 bar (0.015 psi))
	Switch output delay: anywhere between 0...99 s (in increments of 0.1 s)
4-20 (configuration of analog output, only for corresponding electronic version)	Lower range value (LRV) and upper range value (URV) of analog output: – Input value – Acceptance of applied value Anywhere within sensor range (in increments of 0.1 %); turn down up to 4 : 1
	Setting of error current: choice of $\leq 3.6$ mA / $\geq 21.0$ mA / last current value
SERV (service functions)	Resetting of all settings to factory settings
	Static Revision Counter (configuration counter; increases by one with every change in configuration)
	Locking by means of freely selectable code
	Display of last error to occur
	Simulation of switch output and analog output
	Display of max. measured pressure value Display of min. measured pressure value
Note	Measuring ranges with negative gauge pressure up to 4 bar (60 psi) in increments of min. 0.01 mbar (0.15 psi)

### Functions of switch output

- Hysteresis function  
The hysteresis function enables two-point control via a hysteresis. Depending on the pressure  $p$ , the hysteresis can be set via the switch point SP and the switch-back point RSP.
- Window function  
The window function enables the monitoring of a process pressure range.  
The hysteresis of the switch points SP and RSP is less than 0.1 % URL. Under rough EMC conditions quick switching is possible if the measured value is near to SP or RSP. Setting a damping of 0.1 s will avoid this effect.
- NO contact or NC contact  
This switch function is freely selectable.

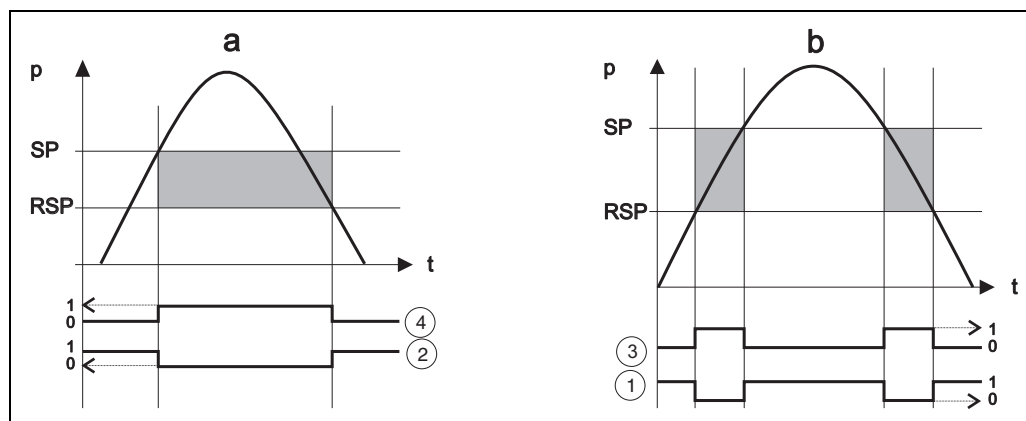

*a Hysteresis function*

*b Window function*


- ① Window NC contact switch status
- ② Hysteresis NC contact switch status
- ③ Window NO contact switch status
- ④ Hysteresis NO contact switch status

*SP Switch point*

*RSP Switch-back point*

**Operation with PC**

The device can be configured with the configuration software ReadWin® 2000 or FieldCare®. For the connection between the USB port of the computer and the device a configuration kit (e. g. TXU10 or FXA291) is necessary.

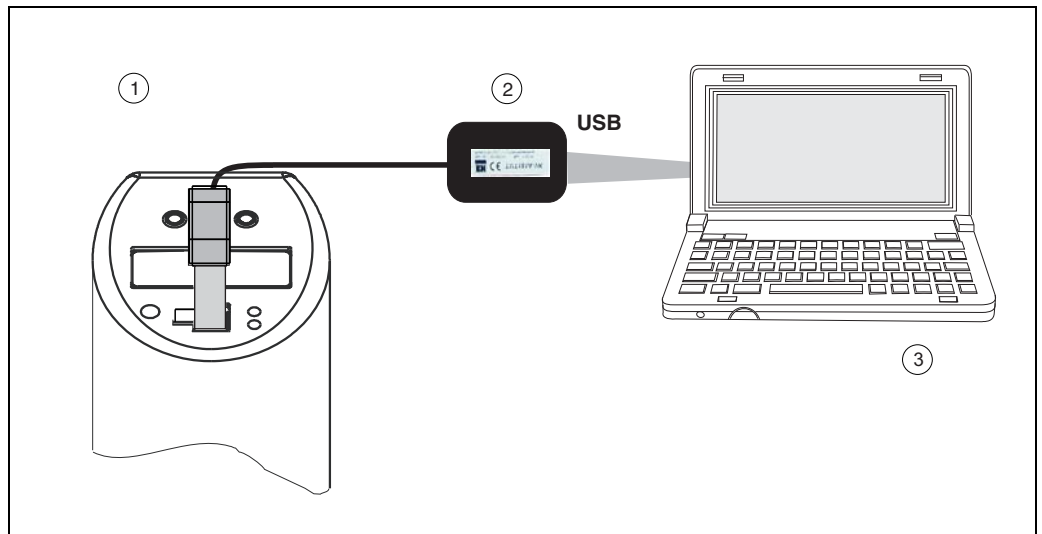

- ① Ceraphant T with communication jack
- ② Configuration kit TXU10-AA or FXA291(USB interface)
- ③ Personal computer with ReadWin® 2000 or FieldCare® configuration software

In addition to the operating options listed in the previous "On-site operation" section, the ReadWin® 2000 or FieldCare® configuration software provides further information on the Ceraphant T:

Function group	Description
SERVICE	Number of switch changes
	Device status/error
INFO	Tag number
	Order code
	Device serial number
	Sensor serial number
	Electronics serial number
	Device release (change status)
	Hardware version
	Software version

Comprehensive information on the ReadWin® 2000 configuration software may be found in the Operating Instructions BA137R/09/en.

The configuration kit TXU10-AA is available as an accessory (see chapter Accessories). For the order of the configuration kit FXA291 or software FieldCare please ask your E+H sales organisation.

## Certificates and approvals

<b>CE mark</b>	The device meets the legal requirements of the EC directives. Endress+Hauser confirms that the device has been successfully tested by applying the CE mark.
<b>UL listing</b>	The device was examined by Underwriters Laboratories Inc. USA (UL) in accordance with the standards UL 61010B-1 and CSA C22.2 No. 1010.1-92 and listed under the number E225237 UL for Canada and the USA.
<b>Pressure Equipment Directive (PED)</b>	This measuring device corresponds to Article 3 (3) of the EC Directive 97/23/EC (Pressure Equipment Directive) and has been designed and manufactured according to good engineering practice.
<b>Suitability for hygienic processes</b>	<p>The Ceraphant T PTP35 is suitable for the employment in hygienic processes. An overview of permitted process connections on page 11 and 12. Many versions meet the requirements of 3A-Sanitary Standard No. 74.</p> <p>Note! The gap-free connections can be cleaned without residue using the usual cleaning methods.</p>
<b>Standards and guidelines</b>	<p>DIN EN 60770 (IEC 60770): Transmitters for use in industrial-process control systems Part 1: Methods for performance evaluation.</p> <p>DIN EN 61003-1, publication date:1993-12 Industrial-process control systems - Instruments with analog inputs and two- or multi-state outputs - Part 1: Methods of evaluating the performance.</p> <p>DIN 16086 Electrical pressure measuring instruments; pressure sensors, pressure transmitters, pressure measuring instruments; concepts, specifications on data sheets</p> <p>IEC 60529 Degrees of protection provided by enclosures (IP code).</p> <p>EN 61326 Electrical equipment for measurement, control and laboratory use - EMC requirements.</p> <p>IEC 61010 Safety requirements for electrical equipment for measurement, control and laboratory use.</p> <p>EN 61000-4-5 Electromagnetic compatibility (EMC) - Part 4: Testing and measurement techniques; Section 5: Surge immunity test</p>



## Ordering Information

### Ceraphant T PTC31

This overview does not mark options which are mutually exclusive.

<b>10</b>	<b>Certificate</b>		
	A	For non-hazardous areas	
<b>20</b>	<b>Electrical connection</b>		
	1	M 12x1 connector: IP 60; with sensors for gauge pressure $\geq 10$ bar and absolute pressure: IP 66	
	2	M16x1.5 valve plug, ISO 4400: IP 60, with sensors for gauge pressure $\geq 10$ bar and absolute pressure: IP 65	
	3	$\frac{1}{2}$ NPT valve plug, ISO 4400: IP 60, with sensors for gauge pressure $\geq 10$ bar and absolute pressure: IP 65	
	4	5 m (16.4 ft) cable: IP 66	
<b>30</b>	<b>Electronics, output signal</b>		
	A	12...30V DC, PNP switch, 3-wire	
	B	12...30V DC, 2 PNP switch, 4-wire	
	C	12...30 V DC, PNP switch + 4...20mA, 4-wire	
<b>40</b>	<b>Display</b>		
	1	With digital display	
<b>50</b>	<b>Sensor</b>		
		Gauge pressure	Max. working pressure MWP
	1C	0...0.1 bar / 0...10 kPa	2.7 bar
	1F	0...0.4 bar / 0...40 kPa	5.3 bar
	1H	0...1 bar / 0...100 kPa	6.7 bar
	1M	0...4 bar / 0...400 kPa	16.7 bar
	1P	0...10 bar / 0...1000 kPa	26.7 bar
	1S	0...40 bar / 0...4000 kPa	40 bar
		Negative gauge pressure	Max. working pressure MWP
	5C	-0.1...0.1 bar / -10...10 kPa	2.7 bar
	5F	-0.4...0.4 bar / -40...40 kPa	5.3 bar
	5H	-1...1 bar / -100...100 kPa	6.7 bar
	5M	-1...4 bar / -100...400 kPa	16.7 bar
	5P	-1...10 bar / -100...1000 kPa	26.7 bar
		Absolute pressure	Max. working pressure MWP
	2F	0...0.4 bar / 0...40 kPa	5.3 bar
	2H	0...1 bar / 0...100 kPa	6.7 bar
	2M	0...4 bar / 0...400 kPa	16.7 bar
	2P	0...10 bar / 0...1000 kPa	26.7 bar
	2S	0...40 bar / 0...4000 kPa	40 bar
		Overload OPL	
			4 bar
			8 bar
			10 bar
			25 bar
			40 bar
			60 bar
<b>60</b>	<b>Configuration and unit</b>		
	1	Sensor range: bar	Calibration in sensor range
	2	Sensor range: kPa/MPa	Calibration in sensor range
	3	Sensor range: psi	Calibration in sensor range
	S	Switch output 1, see additional specification	Calibration in sensor range
	T	Switch output 1 + 2, see additional specification	Calibration in sensor range
	U	Switch and analog output, see additional specification	Calibration in sensor range
	V	Switch output 1, switch output 2 DESINA, see add. spec.	Calibration in sensor range
	W	Analog output, switch output DESINA, see add. spec.	Calibration in sensor range
<b>70</b>	<b>Process connection, material</b>		
	AC	Thread ISO 288, G $\frac{1}{4}$ (female), 316L	
	AD	Thread ISO 228, G $\frac{1}{4}$ A, 316L	
	AE	Thread ISO 228, G $\frac{1}{2}$ A, 316L	
	AF	Thread ISO 228, G $\frac{1}{2}$ A, bore 11 mm, 316L	
	BA	Thread DIN 13, M 12x1.5, 316L	
	CA	Thread 7/16-20 UNF (SAE), 316L	
	DA	Thread ANSI $\frac{1}{4}$ FNPT, 316L	
	DD	Thread ANSI $\frac{1}{2}$ MNPT, 316L	
<b>80</b>	<b>Sensor seal (in contact with process)</b>		
	1	FKM Viton sensor seal	
	4	EPDM sensor seal	
	6	FKM Viton sensor seal, cleaned for O <sub>2</sub> service	
<b>90</b>	<b>Additional equipment</b>		
	A	Without additional equipment	
	B	Final inspection report	
	C	3.1 (process connection), inspection certificate to EN 10204	

<b>90</b>											<b>Additional equipment</b>
											D   Final inspection report + 3.1 (process connection), inspect. certificate to EN 10204
<b>995</b>											<b>Marking:</b>
											1   Tagging (TAG), see additional spec.
PTC31											order code

**Ceraphant T PTP31**

This overview does not mark options which are mutually exclusive.

<b>10</b>	<b>Certificate</b>		
	A	For non-hazardous areas	
<b>20</b>	<b>Electrical connection</b>		
	1	M 12x1 connector: IP 60; with sensors for gauge pressure $\geq 10$ bar and absolute pressure: IP 66	
	2	M16x1.5 valve plug, ISO 4400: IP 60, with sensors for gauge pressure $\geq 10$ bar and absolute pressure: IP 65	
	3	$\frac{1}{2}$ NPT valve plug, ISO 4400: IP 60, with sensors for gauge pressure $\geq 10$ bar and absolute pressure: IP 65	
	4	5 m (16.4 ft) cable: IP 66	
<b>30</b>	<b>Electronics, output signal</b>		
	A	12...30V DC, PNP switch, 3-wire	
	B	12...30V DC, 2 PNP switch, 4-wire	
	C	12...30 V DC, PNP switch + 4...20mA, 4-wire	
<b>40</b>	<b>Display</b>		
	1	With digital display	
<b>50</b>	<b>Sensor</b>		
		Gauge pressure	Max. working pressure MWP
	3H	0...1 bar / 0...100 kPa	2.7 bar
	3M	0...4 bar / 0...400 kPa	10.7 bar
	3P	0...10 bar / 0...1000 kPa	26.7 bar
	3S	0...40 bar / 0...4000 kPa	100 bar
	3U	0...100 bar / 0...10 MPa	100 bar
	3Z	0...400 bar / 0...40 MPa	400 bar
		Negative gauge pressure	Max. working pressure MWP
	7H	-1...1 bar / -100...100 kPa	2.7 bar
	7M	-1...4 bar / -100...400 kPa	10.7 bar
	7P	-1...10 bar / -100...1000 kPa	26.7 bar
		Absolute pressure	Max. working pressure MWP
	4H	0...1 bar / 0...100 kPa	2.7 bar
	4M	0...4 bar / 0...400 kPa	10.7 bar
	4P	0...10 bar / 0...1000 kPa	26.7 bar
	4S	0...40 bar / 0...4000 kPa	100 bar
	4U	0...100 bar / 0...10 MPa	100 bar
	4Z	0...400 bar / 0...40 MPa	400 bar
		Overload OPL	
			4 bar
			16 bar
			40 bar
			160 bar
			160 bar
			600 bar
<b>60</b>	<b>Configuration and unit</b>		
	1	Sensor range: bar	Calibration in sensor range
	2	Sensor range: kPa/MPa	Calibration in sensor range
	3	Sensor range: psi	Calibration in sensor range
	S	Switch output 1, see additional specification	Calibration in sensor range
	T	Switch output 1 + 2, see additional specification	Calibration in sensor range
	U	Switch and analog output, see additional specification	Calibration in sensor range
	V	Switch output 1, switch output 2 DESINA, see add. spec.	Calibration in sensor range
	W	Analog output, switch output DESINA, see add. spec.	Calibration in sensor range
<b>70</b>	<b>Process connection, material</b>		
	AC	Thread ISO 288, G $\frac{1}{4}$ (female), 316L	
	AD	Thread ISO 228, G $\frac{1}{4}$ A, 316L	
	AE	Thread ISO 228, G $\frac{1}{2}$ A, 316L	
	AF	Thread ISO 228, G $\frac{1}{2}$ A, bore 11 mm, 316L	
	AG	Thread ISO 228, G $\frac{1}{2}$ A, seal DIN 3852, 316L, flush-mounted	
	BA	Thread DIN 13, M 12x1.5, 316L	
	CA	Thread 7/16-20 UNF (SAE), 316L	
	DA	Thread ANSI $\frac{1}{4}$ FNPT, 316L	
	DD	Thread ANSI $\frac{1}{2}$ MNPT, 316L	
<b>80</b>	<b>Seal, filling fluid</b>		
	1	O-ring FKM Viton, synthetic oil	
	4	O-ring EPDM, synthetic oil	
	7	Welded, synthetic oil (only for 400 bar sensor)	
<b>90</b>	<b>Additional equipment</b>		
	A	Without additional equipment	
	B	Final inspection report	
	C	3.1 (process connection), inspection certificate to EN 10204	
	D	Final inspection report + 3.1 (process connection), inspect. certificate to EN 10204	

<b>995</b>															<b>Marking:</b>
															1 Tagging (TAG), see additional spec.
PTP31															order code



**Ceraphant T PTP35**

This overview does not mark options which are mutually exclusive.

<b>10</b>	<b>Certificate</b>		
	A	For non-hazardous areas	
<b>20</b>	<b>Electrical connection</b>		
	1	M12x1 connector: IP 60, with sensors for gauge pressure ≥10 bar and absolute pressure: IP 66	
	2	M16x1.5 valve plug, ISO 4400: IP 60; with sensors for gauge pressure ≥10 bar and absolute pressure: IP 65	
	3	½NPT valve plug, ISO 4400: IP 60; with sensors for gauge pressure ≥10 bar and absolute pressure: IP 65	
	4	5 m (16.4 ft) cable: IP 66	
<b>30</b>	<b>Electronics, output signal</b>		
	A	12...30V DC, PNP switch, 3-wire	
	B	12...30V DC, 2 PNP switch, 4-wire	
	C	12...30 V DC, PNP switch + 4...20mA, 4-wire	
<b>40</b>	<b>Display</b>		
	1	With digital display	
<b>50</b>	<b>Sensor</b>		
		Gauge pressure	Max. working pressure MWP
	3H	0...1 bar / 0...100 kPa	2.7 bar
	3M	0...4 bar / 0...400 kPa	10.7 bar
	3P	0...10 bar / 0...1000 kPa	26.7 bar
	3S	0...40 bar / 0...4000 kPa	100 bar
		Overload OPL	
		4 bar	
		16 bar	
		40 bar	
		160 bar	
		Negative gauge pressure	Max. working pressure MWP
	7H	-1...1 bar / -100...100 kPa	2.7 bar
	7M	-1...4 bar / -100...400 kPa	10.7 bar
	7P	-1...10 bar / -100...1000 kPa	26.7 bar
		Overload OPL	
		4 bar	
		16 bar	
		40 bar	
		Absolute pressure	Max. working pressure MWP
	4H	0...1 bar / 0...100 kPa	2.7 bar
	4M	0...4 bar / 0...400 kPa	10.7 bar
	4P	0...10 bar / 0...1000 kPa	26.7 bar
	4S	0...40 bar / 0...4000 kPa	100 bar
		Overload OPL	
		4 bar	
		16 bar	
		40 bar	
		160 bar	
<b>60</b>	<b>Configuration and unit</b>		
	1	Sensor range: bar	
	2	Sensor range: kPa/MPa	
	3	Sensor range: psi	
	S	Switch output 1, see additional specification	
	T	Switch output 1 + 2, see additional specification	
	U	Switch and analog output, see additional specification	
	V	Switch output 1, switch output 2 DESINA, see add. spec.	
	W	Analog output, switch output DESINA, see add. spec.	
		Calibration in sensor range	
		Calibration in sensor range	
		Calibration in sensor range	
		Calibration in sensor range	
		Calibration in sensor range	
		Calibration in sensor range	
		Calibration in sensor range	
		Calibration in sensor range	
<b>70</b>	<b>Process connection, material</b>		
	Clamp connections		
	DA	ISO 2852 DN12-22 (¾"), 316L, 3A, DIN32676, DN10-20	
	DB	ISO 2852 DN25-38 (1...1½"), 316L, 3A, DIN32676, DN25-40	
	DL	ISO 2852 DN40-51 (2"), 316L, 3A, DIN32676, DN50	
	Hygienic connections		
	BA	Thread ISO 228 G1A, metal taper seal, 316L, flush-mounted for sleeve 52005087	
	BB	Thread ISO 228 G1A, O-ring seat seal, 316L, flush-mounted for sleeve 52001051	
	KL	SMS 1½" PN 25, 316L, 3A	
	LB	Varivent F pipe DN 25-32, PN 40, 316L, 3A	
	LL	Varivent N pipe DN4 0-162, PN 40, 316L, 3A	
	PH	DIN 11851 DN 40 PN 40, 316L, 3A	
	PL	DIN 11851 DN 50 PN 25, 316L, 3A	
	HL	APV Inline DN 50 PN 40, 316L, 3A	
<b>80</b>	<b>Seal, filling fluid</b>		
	4	O-ring EPDM, oil conform to FDA	
	8	Without O-ring, oil conform to FDA (only for process connections BA, BB, DA)	
<b>90</b>	<b>Additional equipment</b>		
	A	Without additional equipment	
	B	Final inspection report	
	C	3.1.B process connection, inspection certificate to EN10204	
	D	Final inspection report + 3.1 (process connection), inspect. certificate to EN10204	



**Questionnaire on customer-specific configuration**

The Ceraphant T pressure switch can also be ordered with customised settings. For this purpose, please use the questionnaire below. Information on the desired switch point (SP), switch-back point (RSP), lower range value and upper range value always refer to the pressure unit selected. The possible range of adjustment is indicated in the questionnaire in % of the upper range limit (URL). The bold-printed specifications are the factory settings.

**Questionnaire for Ceraphant PTC31, PTP31, PTP35 for customer-specific setup**

---

**Pressure unit**                       bar               kPa/MPa               psi

---

**Output 1 (Application 1)**  
 Function:                       1 = Window normally closed       3 = Window normally open  
     2 = Hysteresis normally closed       4 = **Hysteresis normally open**

SP:            Range of adjustment: 0,5...100 % URL (in increments of 0.1 %, min. 1 mbar \*)

RSP:            Range of adjustment: 0...99,5 % URL (in increments of 0.1 %, min. 1 mbar \*)

Min. difference SP – RSP: 0,5% URL              \* increments of min. 10 mbar with neg. gauge pressure up to 4 bar

---

**Output 2 (Application 2)** (only if available)  
 Function:  
 1 = Window normally closed       3 = Window normally open                       5 = 4...20 mA (only if available)  
 2 = Hysteresis normally closed       4 = **Hysteresis normally open**

SP:            Range of adjustment: 0,5...100 % URL (in increments of 0.1 %, min. 1 mbar \*)

RSP:            Range of adjustment: 0...99,5 % URL (in increments of 0.1 %, min. 1 mbar \*)  
    \* increments of min. 10 mbar with neg. gauge pressure up to 4 bar

---

**Analogue output** (only if output 2 = 4...20 mA output available)

Range low scale:            Range of adjustment: 0...100 % URL

Range high scale:            Range of adjustment: 0...100 % URL  
    Turn down up to 4 : 1

Failure mode:                       1 = ≤ 3.6 mA               2 = ≥ **21.0 mA**               3 = last current value

---

**Connection conform to DESINA** (only for 2 outputs):       no               yes  
 Hint: See section “Devices Connection”

---


**TAG**                        
 (max. 2 x 18 characters)

P01-PTx3xxxx-10-xx-xx-en-001

## Accessories

### Welding boss – with sealing taper


- Welding boss for flush mounting process connection G1 A with metallic sealing taper (version BA for PTP35)  
Material: AISI 316L  
Order number: 52005087
- Optional with inspection certificate 3.1  
Order number: 52010171
- Welding aid (Dummy) for welding the welding boss without any problems, order number 52005087 or 52010171  
Material: brass  
Order number: 52005272

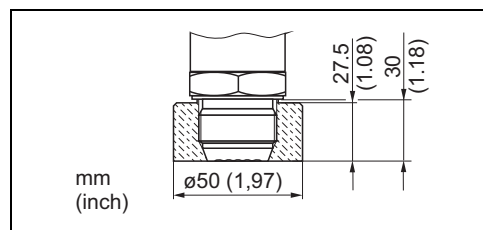

P01-Pxxxxxx-00-xx-00-xx-001

### Welding boss – with sealing surface

- Welding boss for flush mounting process connection G1 A with sealing surface (version BB for PTP35)  
Material: AISI 316L
- Seal (enclosed): silicone O-ring  
Order number: 52001051  
FDA approved materials according to 21 CFR Part 177.1550/2600
- Optional with inspection certificate 3.1:  
Order number: 52011896

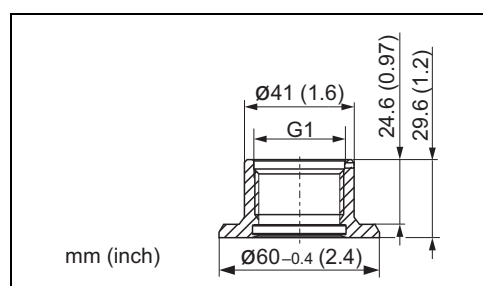

P01-PMP13xxxx-00-xx-00-xx-002

### Thread adapter

- PTP31: order numbers for thread adapter versions

Version AC: order no. 52023980  
Version AD: order no. 52023981  
Version AE: order no. 52023982  
Version AF: order no. 52023983  
Version BA: order no. 52023984  
Version CA: order no. 52023985  
Version DA: order no. 52023986  
Version DD: order no. 52023987

See chapter "Process connection PTP31 Thread connections" → [13](#).

### Clamp adapter

- PTP35: Order numbers for clamp adapter versions

Version DB: order no. 52023994  
Version DL: order no. 52023995

Optional with inspection certificate 3.1:  
Version DB: order no. 52024001  
Version DL: order no. 52024002

See chapter "Process connection PTP35 Clamp connections" → [15](#).

**Hygiene adapter**

- PTP35: order numbers for hygiene adapter versions


Version KL: order no. 52026997  
 Version LB: order no. 52023996  
 Version LL: order no. 52023997  
 Version PH: order no. 52023999  
 Version PL: order no. 52023998  
 Version HL: order no. 52024000

Optional with inspection certificate 3.1:  
 Version KL: order no. 52026999  
 Version LB: order no. 52023996  
 Version LL: order no. 52024004  
 Version PH: order no. 52024006  
 Version PL: order no. 52024005  
 Version HL: order no. 52024007


See chapter "Process connection PTP35 Hygiene connections" → 14.

**Plug-in jack**

- M 12x1 plug-in jack  
 Self-made connection to M 12x1 plug  
 Materials: Body PA  
 Coupling nut: Cu Zn, brass, nickered  
 Protection: IP 67 (fully locked)  
 Order number: 52006263

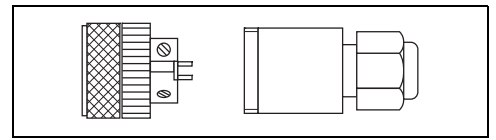


- M 12x1 plug-in jack, elbowed  
 Self-made connection to M 12x1 plug  
 Materials: Body PA  
 Coupling nut: GD-Zn, brass, nickered  
 Protection: IP 67 (fully locked)  
 Order number: 51006327

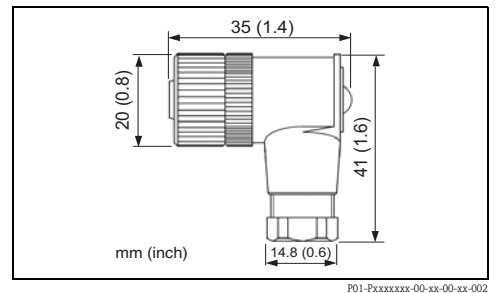


**Connecting cable**

- Cable, 4 x 0.34 mm<sup>2</sup> (AWG 21) with M12 socket, elbowed, screw plug, length 5 m (16 ft), sprayed cable  
 Materials: Body PUR  
 Coupling nut: Cu Zn/Ni, brass, nickered  
 Cable: PVC  
 Protection: IP 67 (fully locked)  
 order number: 52010285
- Cable, 4 x 0.34 mm<sup>2</sup> (AWG 21) with M12 socket, with LED, elbowed, sprayed cable, length 5 m (16 ft), specially for hygiene applications (For devices with switch output only)  
 Materials: Body: PVC  
 Coupling nut: 316L  
 Cable: PVC  
 Protection: IP 69K (fully locked)  
 Order number: 52018763  
 Display: gn: device operational;  
 ye1: switch status; ye 2: switch status 2

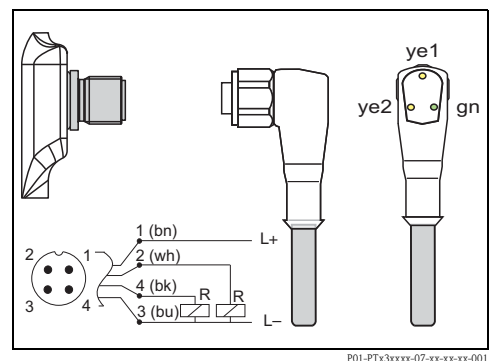

**Configuration kit**

- Configuration kit for PC-programmable transmitters. Setup program and interface cable for PCs with USB port. Adapter for transmitters with 4-pin post connector. Order code: TXU10-AA
- ReadWin® 2000 is supplied with the configuration kit or it can be downloaded free of charge directly from the internet at the following address: [www.readwin2000.com](http://www.readwin2000.com)

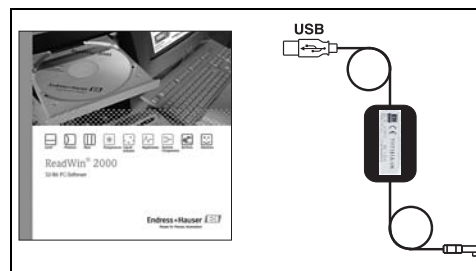

P01-P1xx3xxx-00-xx-00-xx-001

**Power supply RNB130**

- Primary switched-mode power supply for sensors
- Space saving DIN rail mounting as per IEC 60715.
- Nominal input voltage: 100-240 V AC (wide-range voltage input)
- Output voltage: 24 V DC, max. 30 V in the event of a fault
- Nominal output current: 1.5 A
- Connection to monophased a.c. networks or to two phase conductors of three-phase supply networks

## Documentation

This supplementary documentation can be found on our product pages on [www.endress.com](http://www.endress.com)

---

<b>Field of Activities</b>	Pressure measurement, Powerful instruments for process pressure, differential pressure, level and flow: FA004P/00/EN
<b>Technical Information</b>	Technical Information on the Thermophant T temperature switch: <ul style="list-style-type: none"><li>■ Thermophant T TTR31, TTR35: TI105R/09/EN</li><li>■ Flowphant T DTT31, DTT35: TI125R/09/EN</li></ul>
<b>Operating instructions</b>	<ul style="list-style-type: none"><li>■ Ceraphant T PTC31, PTP31, PTP35: KA225P/00/EN</li><li>■ Operating software ReadWin 2000: BA137R/09/EN</li><li>■ Operating software FieldCare: BA027S/04/C4</li></ul>

---

---

## Instruments International

Endress+Hauser  
Instruments International AG  
Kaegenstrasse 2  
4153 Reinach  
Switzerland

Tel. +41 61 715 81 00  
Fax +41 61 715 25 00  
[www.endress.com](http://www.endress.com)  
[info@ii.endress.com](mailto:info@ii.endress.com)

**Endress+Hauser** 

People for Process Automation

TI384P/00/EN/10.09  
71102969  
FM+SGML 6.0



71102969