DATASHEET - M22-KC01



Contact element, 1 N/C, base fixing, 6. contact, screw connection

Powering Business Worldwide*

 Part no.
 M22-KC01

 Catalog No.
 216382


 Eaton Catalog No.
 M22-KC010

 EL-Nummer
 4355366

(Norway)

Delivery programProduct range

| 71 - 3 - | | |
|--|----|--|
| Product range | | Accessories |
| Part group reference (e.g. DIL) | | M22 |
| Basic function accessories | | Contact elements |
| Single unit/Complete unit | | Element |
| Connection technique | | Screw terminals |
| Fixing | | Base fixing |
| Degree of Protection | | IP20 |
| Connection to SmartWire-DT | | no |
| Approval | | ET 16107 Sicherheit geprüft tested safety |
| Contacts | | |
| N/C = Normally closed | | 1 NC → |
| Notes | | e safety function, by positive opening to IEC/EN 60947-5-1 |
| Actuator travel and actuation force as per DIN EN 60947-5-1, K.5.4.1 | | |
| | mm | 4.8 |
| Maximum travel | mm | 5.7 |
| Minimum force for positive opening | N | 15 |
| | | |

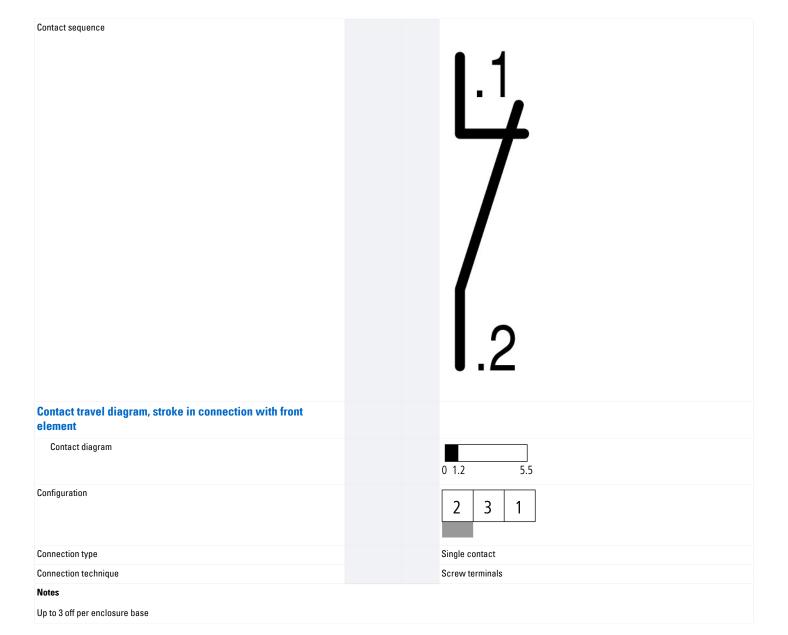

Technical data

| General | | | |
|---|--------------|-------------------|--|
| Standards | | | IEC 60947-5-1 |
| Lifespan, mechanical | Operations | x 10 ⁶ | >5 |
| Operating frequency | Operations/h | | ≦ 3600 |
| Actuating force | | n | ≦5 |
| Operating torque (screw terminals) | | Nm | ≦ 0.8 |
| Degree of Protection | | | IP20 |
| Climatic proofing | | | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| Ambient temperature | | | |
| Open | | °C | -25 - +70 |
| Mechanical shock resistance to IEC 60068-2-27 Shock duration 11 ms, half-sinusoidal | | g | > 30 |
| Terminal capacities | | mm^2 | |
| Solid | | mm ² | 0.75 - 2.5 |
| Stranded | | mm ² | 0.5 - 2.5 |
| Flexible with ferrule | | mm^2 | 0.5 - 1.5 |
| Contacts | | | |

| ~ | | | | | |
|---|---|---|----|---|----|
| ш | n | n | ta | m | re |

| Rated impulse withstand voltage | U_{imp} | V AC | 6000 |
|---------------------------------------|-----------|------|-------|
| Rated insulation voltage | Ui | V | 500 |
| Overvoltage category/pollution degree | | | III/3 |
| Control circuit reliability | | | |

| at 24 V DC/5 mA | H _F | Fault probabili | < 10 ⁻⁷ (i.e. 1 failure to 10 ⁷ operations) |
|---|------------------|--------------------|---|
| at 5 V DC/1 mA | H _F | Fault probabili | $< 5 \times 10^{-6}$ (i.e. 1 failure in 5 x 10^{6} operations) |
| Max. short-circuit protective device | | | |
| Fuseless | | Туре | PKZM0-10/FAZ-B6/1 |
| Fuse | gG/gL | Α | 10 |
| Switching capacity | | | |
| Rated operational current | l _e | Α | |
| AC-15 | | | |
| 115 V | l _e | Α | 6 |
| 220 V 230 V 240 V | I _e | Α | 6 |
| 380 V 400 V 415 V | I _e | Α | 4 |
| 500 V | I _e | Α | 2 |
| DC-13 | | | |
| 24 V | l _e | Α | 3 |
| 42 V | I _e | Α | 1.7 |
| 60 V | l _e | Α | 1.2 |
| 110 V | I _e | Α | 0.6 |
| 220 V | I _e | Α | 0.3 |
| Lifespan, electrical | | | |
| AC-15 | | | |
| 230 V/0.5 A | Operations | x 10 ⁶ | 1.6 |
| 230 V/1.0 A | Operations | x 10 ⁶ | 1 |
| 230 V/3.0 A | Operations | x 10 ⁶ | 0.7 |
| DV-13 | | | |
| 12 V/2.8 A | Operations | x 10 ⁶ | 1.2 |
| Auxiliary contacts | | | |
| Rated conditional short-circuit current | $I_{\mathbf{q}}$ | kA | 1 |
| | | | |

Design verification as per IEC/EN 61439

| Technical data for design verification | | | |
|--|-------------------|----|--|
| Rated operational current for specified heat dissipation | In | Α | 6 |
| Heat dissipation per pole, current-dependent | P _{vid} | W | 0.11 |
| Equipment heat dissipation, current-dependent | P _{vid} | W | 0 |
| Static heat dissipation, non-current-dependent | P _{vs} | W | 0 |
| Heat dissipation capacity | P _{diss} | W | 0 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| 10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | | Is the panel builder's responsibility. |

| 10.8 Connections for external conductors | Is the panel builder's responsibility. |
|--|--|
| 10.9 Insulation properties | |
| 10.9.2 Power-frequency electric strength | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | Is the panel builder's responsibility. |
| 10.10 Temperature rise | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.12 Electromagnetic compatibility | Is the panel builder's responsibility. The specifications for the switchgear must be observed. |
| 10.13 Mechanical function | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |

Technical data ETIM 6.0

Low-voltage industrial components (EG000017) / Auxiliary contact block (EC000041)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Component for low-voltage switching technology / Auxiliary switch block (ecl@ss8.1-27-37-13-02 [AKN342010])

Number of contacts as change-over contact


0

| Number of contacts as change-over contact | | U |
|---|---|------------------|
| Number of contacts as normally open contact | | 0 |
| Number of contacts as normally closed contact | | 1 |
| Rated operation current le at AC-15, 230 V | Α | 6 |
| Type of electric connection | | Screw connection |
| Model | | Top mounting |
| Mounting method | | Floor fastening |

Approvals

| Product Standards | IEC/EN 60947-5; UL 508; CSA-C22.2 No. 14-05; CSA-C22.2 No. 94-91; CE marking |
|-----------------------------|--|
| UL File No. | E29184 |
| UL Category Control No. | NKCR |
| CSA File No. | 012528 |
| CSA Class No. | 3211-03 |
| North America Certification | UL listed, CSA certified |
| Degree of Protection | UL/CSA Type: - |

Dimensions

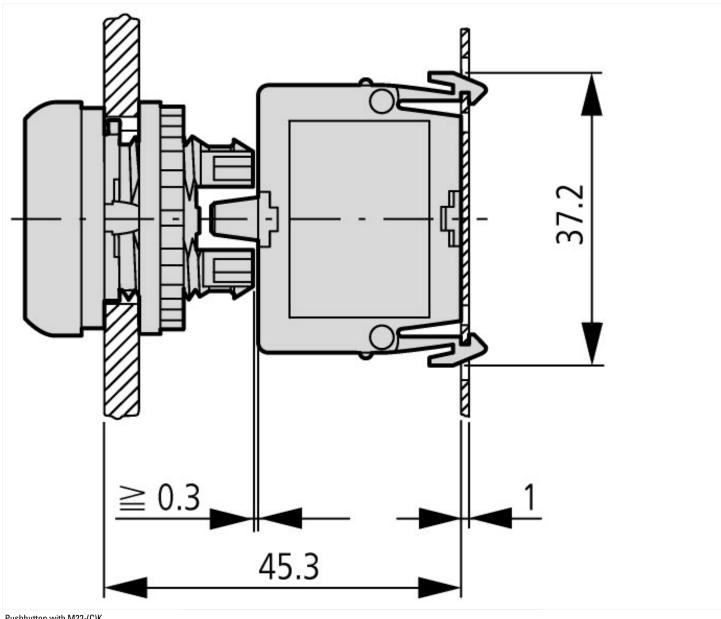

Pushbutton with M22-(C)K... Pushbutton with M22-(C) LED... + M22-XLED...

Assets (Links)

Declaration of Conformity 00002595

Additional product information (links)

| IL04716002Z (AWA1160-1745) RMQ-Titan Syste | om . |
|--|--|
| IL04716002Z (AWA1160-1745) RMQ-Titan System | ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL04716002Z2017_01.pdf |
| DGUV Test Mark Customer Information | http://www.dguv.de/medien/dguv-test-medien/_pdf_zip_doc_ppt/agb-und-pzo/dguv_test_zeichen_infoblatt_kunden.pdf |