



## Main switch assembly kit, left side red

**Part no.** NZM2-XSR-L  
**Article no.** 266654



Powering Business Worldwide™

### Actuation of the switch on the control panel side wall

#### Switch mounting on mounting plate

Equipment supplied:

- Door coupling rotary handle
- NZM...-XV4 extension shaft
- External warning plate/designation label in German/English
- Black and yellow flash

For enhanced busbar tag shroud on the incomer side, IP2X protection against contact with a finger can be ordered, → 266744

Other external warning plates/designation labels can be clipped on.

Protection type IP66/UL/CSA Type 4x, Type 12

### Delivery programme

Equipment supplied			Door coupling rotary handle with rotary drive NZM...-XV4 extension shaft External warning plate/marketing plate in German/English Black and yellow lightning symbol
Function			Red-yellow for emergency switching off
Protection class			IP66 UL/CSA Type 4X, Type 12
Locking facility			lockable on the 0 position on the handle using up to 3 padlocks
Project planning information			External warning plate/designation label can be clipped on. For enhanced busbar tag shroud on the incomer side, please order IP2X protection against contact with a finger.
Actuation			Actuation on the left
For use with			NZM2(-4) PN2(-4), N(S)2(-4)


### Approvals

Product Standards	UL489; CSA-C22.2 No. 5-09; IEC60947, CE marking
UL File No.	E140305
UL CCN	DIHS
CSA File No.	022086
CSA Class No.	1437-01
NA Certification	UL listed, CSA certified
Degree of Protection	IEC: IP66, UL/CSA Type 4X, 12

### Technical data ETIM 4.0

Lockable			Yes
Colour			Red
Suitable for emergency stop			Yes
With axe			Yes
Suitable for power circuit breaker			Yes
Suitable for switch disconnecter			Yes

### Dimensions

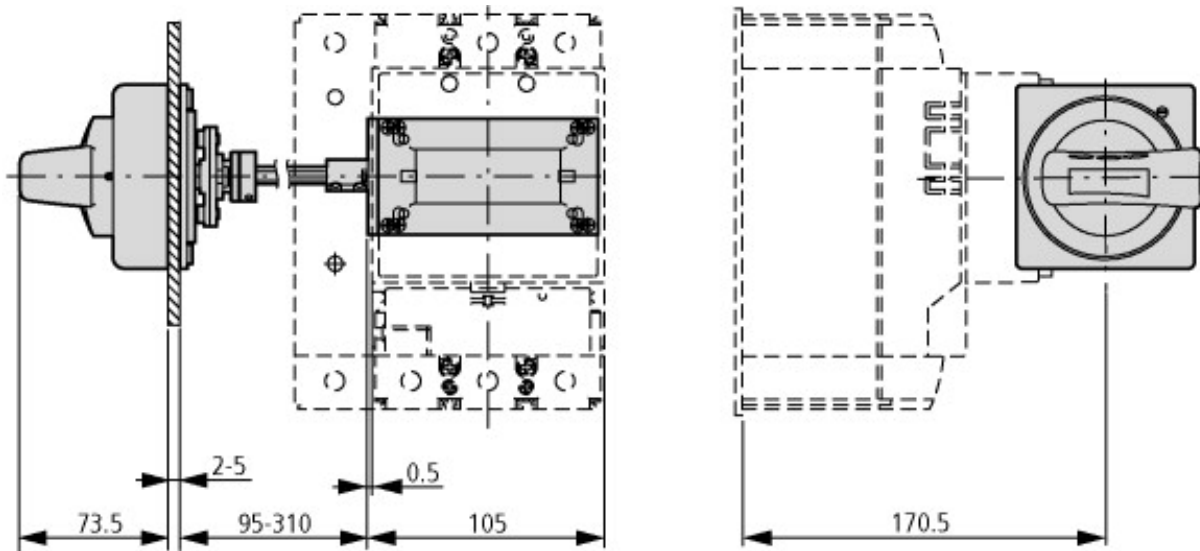

NZM2-XS(R)-L

**Additional product information (links)**

**IL01206004Z (AWA1230-2051) Side wall actuator NZM2**

IL01206004Z (AWA1230-2051) Side wall actuator NZM2

[ftp://ftp.moeller.net/DOCUMENTATION/AWA\\_INSTRUCTIONS/IL01206004Z2010\\_11.pdf](ftp://ftp.moeller.net/DOCUMENTATION/AWA_INSTRUCTIONS/IL01206004Z2010_11.pdf)